

# **PROBLEM SUMMARY**

Sample Rating Trend

ISO

100755.1 (S/N 1417)

Component


Compressor

KAESER SIGMA (OEM) M-460 (--- GAL)





### **COMPONENT CONDITION SUMMARY**

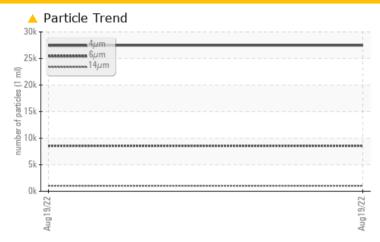

### RECOMMENDATION

No corrective action is recommended at this time. Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

PROBLEMATIC TEST RESULTS							
Sample Status			ABNORMAL				
Particles >6µm	ASTM D7647	>1300	<u> </u>				
Particles >14µm	ASTM D7647	>80	<b>1032</b>				
Particles >21µm	ASTM D7647	>20	<b>255</b>				
Particles >38µm	ASTM D7647	>4	<b>4</b> 24				
Oil Cleanliness	ISO 4406 (c)	>/17/13	<u>22/20/17</u>				

Customer Id: MACASH Sample No.: KCP28639 Lab Number: 05633661 Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data: Doug Bogart +1 (800)237-1369 x4016 dougb@wearcheckusa.com

To change component or sample information: Customer Service +1 1-800-237-1369 customerservice@wearcheck.com

RECOMMENDED ACTIONS						
Action	Status	Date	Done By	Description		
Change Fluid			?	Oil and filter change at the time of sampling has been noted.		
Change Filter			?	Oil and filter change at the time of sampling has been noted.		

# HISTORICAL DIAGNOSIS



# **OIL ANALYSIS REPORT**

Sample Rating Trend



100755.1 (S/N 1417)

Component

Compressor

KAESER SIGMA (OEM) M-460 (--- GAL)

### **DIAGNOSIS**

#### Recommendation

No corrective action is recommended at this time. Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

#### Wear

All component wear rates are normal.

### Contamination

There is a high amount of particulates present in the oil.


#### **Fluid Condition**

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.


				Aug2022		
SAMPLE INFORM	AATIONI	mathad			history 1	hiotom. O
	MATION	method	limit/base	current	history 1	history 2
Sample Number				KCP28639		
Sample Date				19 Aug 2022		
Machine Age	hrs			23609		
Oil Age	hrs			0		
Oil Changed				Changed		
Sample Status				ABNORMAL		
WEAR METALS		method	limit/base	current	history 1	history 2
Iron	ppm	ASTM D5185m	>50	2		
Chromium	ppm	ASTM D5185m	>10	0		
Nickel	ppm	ASTM D5185m	>3	0		
Titanium	ppm	ASTM D5185m	>3	0		
Silver	ppm	ASTM D5185m	>2	0		
Aluminum	ppm	ASTM D5185m	>10	<1		
Lead	ppm	ASTM D5185m	>10	<1		
Copper	ppm	ASTM D5185m	>50	12		
Tin	ppm	ASTM D5185m	>10	<1		
Vanadium	ppm	ASTM D5185m		0		
Cadmium	ppm	ASTM D5185m		0		
ADDITIVES	PPIII	method	limit/base		biotom, 1	hiotom, O
ADDITIVES				current	history 1	history 2
Boron	ppm	ASTM D5185m	0	0		
Barium	ppm	ASTM D5185m	90	2		
Molybdenum	ppm	ASTM D5185m	0	0		
Manganese	ppm	ASTM D5185m		0		
Magnesium	ppm	ASTM D5185m	100	33		
Calcium	ppm	ASTM D5185m	0	0		
Phosphorus	ppm	ASTM D5185m	0	5		
Zinc	ppm	ASTM D5185m	0	28		
Sulfur	ppm	ASTM D5185m	23500	18555		
CONTAMINANTS	1	method	limit/base	current	history 1	history 2
Silicon	ppm	ASTM D5185m	>25	<1		
Sodium	ppm	ASTM D5185m		10		
Potassium	ppm	ASTM D5185m	>20	3		
Water	%	ASTM D6304	>0.05	0.017		
ppm Water	ppm	ASTM D6304	>500	172.3		
FLUID CLEANLIN	IESS	method	limit/base	current	history 1	history 2
Particles >4µm		ASTM D7647		27474		
Particles >6µm		ASTM D7647	>1300	<u>A</u> 8561		
Particles >14µm		ASTM D7647	>80	<b>1032</b>		
Particles >21µm		ASTM D7647	>20	<u>^</u> 255		
Particles >38µm		ASTM D7647	>4	<u> </u>		
Particles >71μm		ASTM D7647	>3	2		
Oil Cleanliness		ISO 4406 (c)	>/17/13	<u>22/20/17</u>		
FLUID DEGRADA	TION	method	limit/base	current	history 1	history 2
Acid Number (AN)	mg KOH/g	ASTM D8045	1.0	0.35		



## **OIL ANALYSIS REPORT**

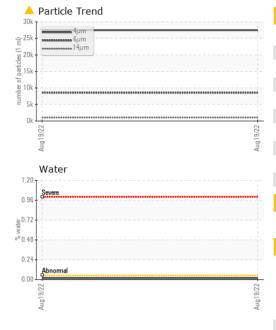

VISUAL		method	limit/base	current	history 1	history 2
White Metal	scalar	*Visual	NONE	NONE		
Yellow Metal	scalar	*Visual	NONE	NONE		
Precipitate	scalar	*Visual	NONE	NONE		
Silt	scalar	*Visual	NONE	NONE		
Debris	scalar	*Visual	NONE	LIGHT		
Sand/Dirt	scalar	*Visual	NONE	NONE		
Appearance	scalar	*Visual	NORML	NORML		
Odor	scalar	*Visual	NORML	NORML		
Emulsified Water	scalar	*Visual	>0.05	NEG		
Free Water	scalar	*Visual		NEG		
FLUID PROPERT	ΓIES	method	limit/base	current	history 1	history 2
Visc @ 40°C	cSt	ASTM D445	45	49.2		
SAMPLE IMAGES		method	limit/base	current	history 1	history 2
Color					no image	no image
Bottom					no image	no image

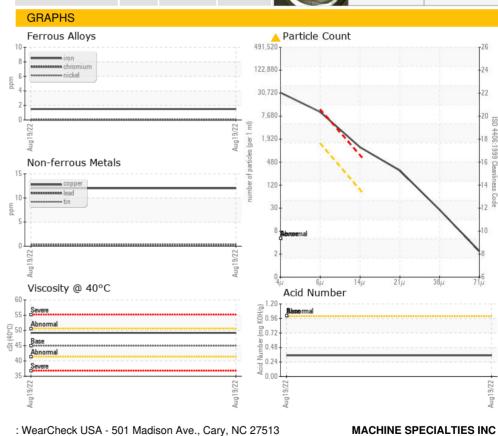



Laboratory Sample No. Lab Number Unique Number : 10118182

: KCP28639 : 05633661

Received

: 02 Sep 2022 Diagnosed : 06 Sep 2022

Diagnostician : Doug Bogart

Test Package : IND 2 ( Additional Tests: KF, PrtCount ) Certificate L2367 To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

**MACHINE SPECIALTIES INC** 

9989 LICKINGHOLE RD ASHLAND, VA

USA 23005 Contact: Service Manager

T: F: