


PROBLEM SUMMARY

Sample Rating Trend




WATER

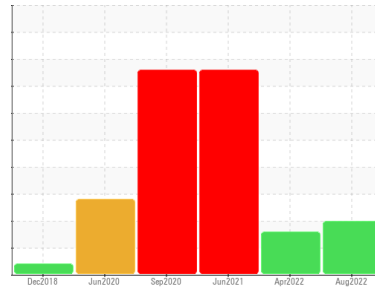

Machine Id
KAESER ASD 40 6366254 (S/N 1493)
Component
Compressor
Fluid
KAESER SIGMA (OEM) S-460 (--- GAL)

COMPONENT CONDITION SUMMARY

▲ Water

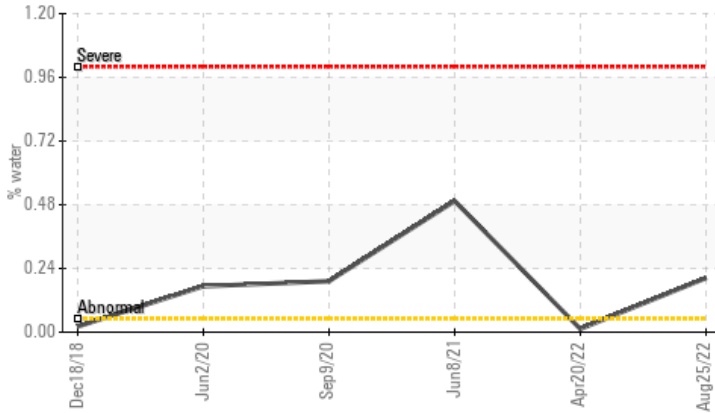

RECOMMENDATION

The filter change at the time of sampling has been noted. We advise that you stop the unit and follow the water drain-off procedure for this component. We recommend an early resample in 500 hours to monitor this condition. We were unable to perform a particle count due to a high concentration of particles present in this sample.

PROBLEMATIC TEST RESULTS

Sample Status				ABNORMAL	ABNORMAL	SEVERE
Water	%	ASTM D6304	>0.05	▲ 0.204	0.012	▲ 0.494
ppm Water	ppm	ASTM D6304	>500	▲ 2040	126.1	▲ 4940
Debris	scalar	*Visual	NONE	▲ MODER	LIGHT	▲ MODER
Emulsified Water	scalar	*Visual	>0.05	▲ 0.2%	NEG	NEG

Customer Id: VALFAY
Sample No.: KCP30946
Lab Number: 05635033
Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:
Don Baldrige +1
don.b505@comcast.net

To change component or sample information:
Customer Service +1 1-800-237-1369
customerservice@wearcheck.com

RECOMMENDED ACTIONS

Action	Status	Date	Done By	Description
Alert	---	---	?	We were unable to perform a particle count due to a high concentration of particles present in this sample.

HISTORICAL DIAGNOSIS

20 Apr 2022 Diag: Jonathan Hester

ISO



Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor. All component wear rates are normal. There is a high amount of particulates present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report



08 Jun 2021 Diag: Don Baldrige

WATER



Oil and filter change at the time of sampling has been noted. We recommend an early resample in 500 hours to monitor this condition. We were unable to perform a particle count due to a high concentration of particles present in this sample. The iron level is abnormal. All other component wear rates are normal. Excessive free water present. There is a moderate concentration of water present in the oil. Moderate concentration of visible dirt/debris present in the oil. The AN level is acceptable for this fluid.

view report



09 Sep 2020 Diag: Jonathan Hester


WATER



We advise that you stop the unit and follow the water drain-off procedure for this component. The filter change at the time of sampling has been noted. We recommend an early resample in 500 hours to monitor this condition. We were unable to perform a particle count due to a high concentration of particles present in this sample. All component wear rates are normal. Excessive free water present. There is a light concentration of water present in the oil. Moderate concentration of visible dirt/debris present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report



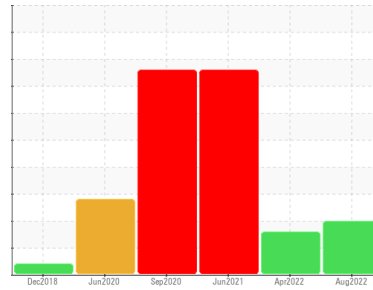

Machine Id
KAESER ASD 40 6366254 (S/N 1493)

Component
Compressor
Fluid
KAESER SIGMA (OEM) S-460 (--- GAL)

DIAGNOSIS

▲ Recommendation

The filter change at the time of sampling has been noted. We advise that you stop the unit and follow the water drain-off procedure for this component. We recommend an early resample in 500 hours to monitor this condition. We were unable to perform a particle count due to a high concentration of particles present in this sample.

Wear

All component wear rates are normal.

▲ Contamination

Moderate concentration of visible dirt/debris present in the oil. There is a light concentration of water present in the oil.

Fluid Condition

The AN level is acceptable for this fluid.

SAMPLE INFORMATION

method	limit/base	current	history 1	history 2
Sample Number		KCP30946	KCP45608	KCP32849
Sample Date		25 Aug 2022	20 Apr 2022	08 Jun 2021
Machine Age	hrs	30318	27602	21038
Oil Age	hrs	3000	2345	0
Oil Changed		Not Changed	Changed	Changed
Sample Status		ABNORMAL	ABNORMAL	SEVERE

WEAR METALS

method	limit/base	current	history 1	history 2
Iron ppm	ASTM D5185m >50	<1	1	▲ 48
Chromium ppm	ASTM D5185m >10	0	0	0
Nickel ppm	ASTM D5185m >3	<1	0	0
Titanium ppm	ASTM D5185m >3	0	0	0
Silver ppm	ASTM D5185m >2	0	0	0
Aluminum ppm	ASTM D5185m >10	7	<1	0
Lead ppm	ASTM D5185m >10	0	0	<1
Copper ppm	ASTM D5185m >50	22	6	11
Tin ppm	ASTM D5185m >10	<1	0	0
Antimony ppm	ASTM D5185m	---	---	0
Vanadium ppm	ASTM D5185m	0	0	0
Cadmium ppm	ASTM D5185m	0	0	0

ADDITIVES

method	limit/base	current	history 1	history 2
Boron ppm	ASTM D5185m	0	0	<1
Barium ppm	ASTM D5185m 90	0	0	3
Molybdenum ppm	ASTM D5185m	0	0	0
Manganese ppm	ASTM D5185m	0	0	<1
Magnesium ppm	ASTM D5185m 90	2	<1	9
Calcium ppm	ASTM D5185m 2	0	0	<1
Phosphorus ppm	ASTM D5185m	1	0	14
Zinc ppm	ASTM D5185m	4	0	8
Sulfur ppm	ASTM D5185m	13213	9334	16964

CONTAMINANTS

method	limit/base	current	history 1	history 2
Silicon ppm	ASTM D5185m >25	<1	<1	0
Sodium ppm	ASTM D5185m	2	0	0
Potassium ppm	ASTM D5185m >20	0	<1	0
Water %	ASTM D6304 >0.05	▲ 0.204	0.012	▲ 0.494
ppm Water	ASTM D6304 >500	▲ 2040	126.1	▲ 4940


FLUID CLEANLINESS

method	limit/base	current	history 1	history 2
Particles >4µm	ASTM D7647	---	126529	---
Particles >6µm	ASTM D7647 >1300	---	▲ 25196	---
Particles >14µm	ASTM D7647 >80	---	▲ 1191	---
Particles >21µm	ASTM D7647 >20	---	▲ 395	---
Particles >38µm	ASTM D7647 >4	---	▲ 9	---
Particles >71µm	ASTM D7647 >3	---	0	---
Oil Cleanliness	ISO 4406 (c) >17/13	---	▲ 22/17	---

FLUID DEGRADATION

method	limit/base	current	history 1	history 2
Acid Number (AN) mg KOH/g	ASTM D8045 0.4	0.37	0.42	0.312


OIL ANALYSIS REPORT

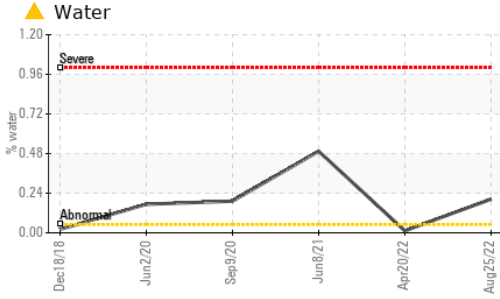






VISUAL	method	limit/base	current	history 1	history 2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	▲ MODER	▲ MODER
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	▲ 0.2%	NEG
Free Water	scalar	*Visual		▲ 5.0	NEG

FLUID PROPERTIES	method	limit/base	current	history 1	history 2
Visc @ 40°C	cSt	ASTM D445	46	44.4	45.0

SAMPLE IMAGES	method	limit/base	current	history 1	history 2
---------------	--------	------------	---------	-----------	-----------

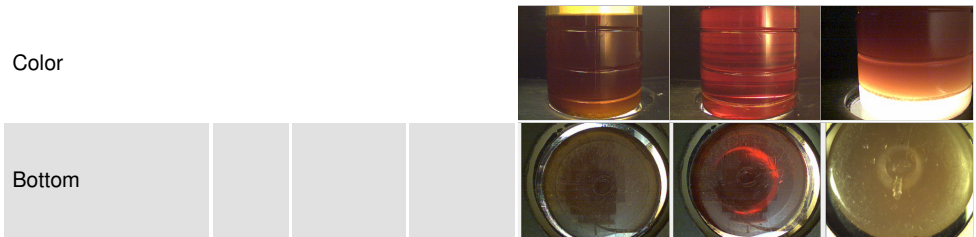

GRAPHS

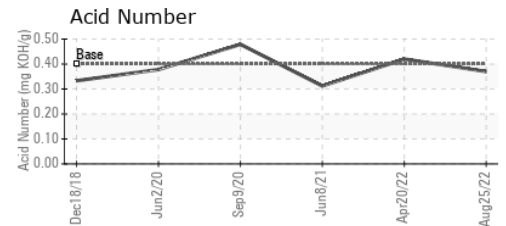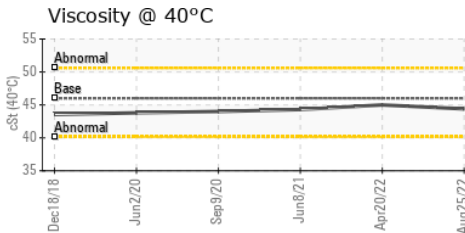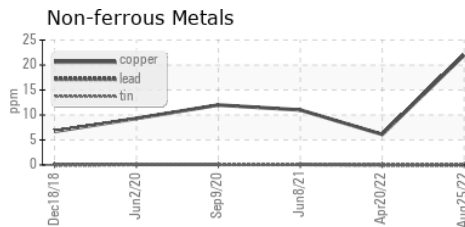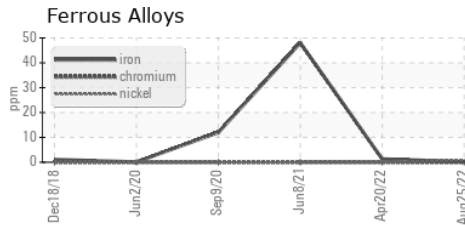

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : KCP30946 **Received** : 06 Sep 2022
Lab Number : 05635033 **Diagnosed** : 08 Sep 2022
Unique Number : 10124563 **Diagnostician** : Don Baldrige
Test Package : IND 2 (Additional Tests: KF, PrtCount)

VALLEY PROTEINS
 1309 INDUSTRIAL DR
 FAYETTEVILLE, NC
 USA 28301
 Contact:

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:
F: