


PROBLEM SUMMARY

Sample Rating Trend



ISO

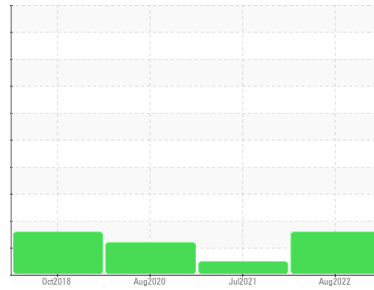


Machine Id
KAESER AS 25T 4342884 (S/N 1002)

Component
Compressor

Fluid
KAESER SIGMA (OEM) M-460 (--- GAL)

COMPONENT CONDITION SUMMARY

▲ Particle Trend

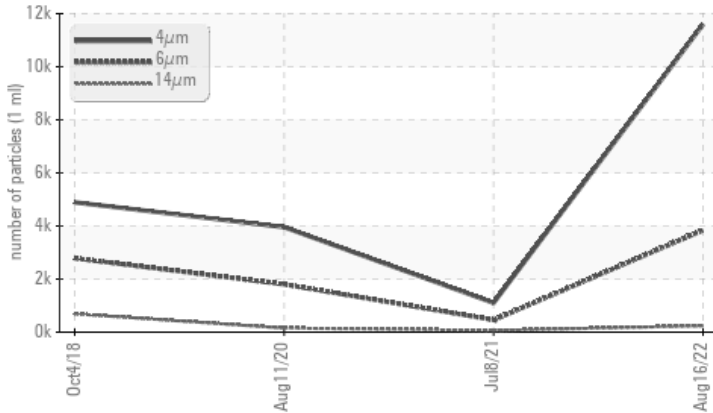

RECOMMENDATION

No corrective action is recommended at this time. Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

PROBLEMATIC TEST RESULTS

Sample Status			ABNORMAL	NORMAL	ATTENTION
Particles >6µm	ASTM D7647	>1300	▲ 3841	455	▲ 1801
Particles >14µm	ASTM D7647	>80	▲ 240	62	▲ 153
Particles >21µm	ASTM D7647	>20	▲ 24	14	▲ 36
Oil Cleanliness	ISO 4406 (c)	>--/17/13	▲ 21/19/15	16/13	▲ 18/14

Customer Id: CABBAL
Sample No.: KCP49362
Lab Number: 05635050
Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:
Don Baldrige +1
don.b505@comcast.net

To change component or sample information:
Customer Service +1 1-800-237-1369
customerservice@wearcheck.com

RECOMMENDED ACTIONS

Action	Status	Date	Done By	Description
Change Fluid	---	---	?	Oil and filter change at the time of sampling has been noted.
Change Filter	---	---	?	Oil and filter change at the time of sampling has been noted.

HISTORICAL DIAGNOSIS

08 Jul 2021 Diag: Angela Borella

NORMAL



Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor. All component wear rates are normal. The amount and size of particulates present in the system are acceptable. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

[view report](#)



11 Aug 2020 Diag: Don Baldrige

ISO



Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor. All component wear rates are normal. There is a moderate amount of particulates present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

[view report](#)



04 Oct 2018 Diag: Jonathan Hester

ISO




Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor. All component wear rates are normal. There is a high amount of particulates present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

[view report](#)



Machine Id
KAESER AS 25T 4342884 (S/N 1002)

Component
Compressor
Fluid
KAESER SIGMA (OEM) M-460 (--- GAL)

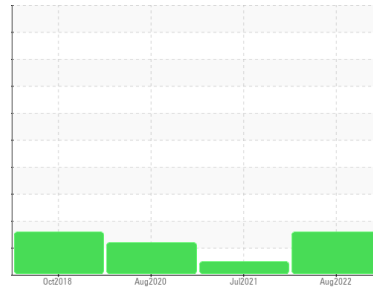

DIAGNOSIS

Recommendation

No corrective action is recommended at this time. Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is a high amount of particulates present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

	method	limit/base	current	history 1	history 2
Sample Number			KCP49362	KCP42261	KCP24891
Sample Date			16 Aug 2022	08 Jul 2021	11 Aug 2020
Machine Age	hrs		27930	24533	21672
Oil Age	hrs		3397	1500	2670
Oil Changed			Changed	Changed	Changed
Sample Status			ABNORMAL	NORMAL	ATTENTION

WEAR METALS

	method	limit/base	current	history 1	history 2
Iron	ppm ASTM D5185m	>50	<1	0	<1
Chromium	ppm ASTM D5185m	>10	0	0	0
Nickel	ppm ASTM D5185m	>3	0	0	0
Titanium	ppm ASTM D5185m	>3	0	0	0
Silver	ppm ASTM D5185m	>2	0	0	0
Aluminum	ppm ASTM D5185m	>10	<1	<1	<1
Lead	ppm ASTM D5185m	>10	0	0	0
Copper	ppm ASTM D5185m	>50	18	6	8
Tin	ppm ASTM D5185m	>10	<1	<1	<1
Antimony	ppm ASTM D5185m		---	0	<1
Vanadium	ppm ASTM D5185m		0	0	0
Cadmium	ppm ASTM D5185m		0	0	0

ADDITIVES

	method	limit/base	current	history 1	history 2
Boron	ppm ASTM D5185m	0	3	17	0
Barium	ppm ASTM D5185m	90	0	0	0
Molybdenum	ppm ASTM D5185m	0	0	0	0
Manganese	ppm ASTM D5185m		0	0	<1
Magnesium	ppm ASTM D5185m	100	14	34	35
Calcium	ppm ASTM D5185m	0	0	0	0
Phosphorus	ppm ASTM D5185m	0	2	5	<1
Zinc	ppm ASTM D5185m	0	54	52	69
Sulfur	ppm ASTM D5185m	23500	19597	19035	24315

CONTAMINANTS

	method	limit/base	current	history 1	history 2
Silicon	ppm ASTM D5185m	>25	<1	0	1
Sodium	ppm ASTM D5185m		3	11	13
Potassium	ppm ASTM D5185m	>20	0	1	3
Water	% ASTM D6304	>0.05	0.015	0.016	0.023
ppm Water	ppm ASTM D6304	>500	157.3	162.4	233.7



FLUID CLEANLINESS

	method	limit/base	current	history 1	history 2
Particles >4µm	ASTM D7647		11596	1101	3957
Particles >6µm	ASTM D7647	>1300	▲ 3841	455	▲ 1801
Particles >14µm	ASTM D7647	>80	▲ 240	62	▲ 153
Particles >21µm	ASTM D7647	>20	▲ 24	14	▲ 36
Particles >38µm	ASTM D7647	>4	1	0	2
Particles >71µm	ASTM D7647	>3	0	0	0
Oil Cleanliness	ISO 4406 (c)	>--/17/13	▲ 21/19/15	16/13	▲ 18/14

FLUID DEGRADATION

	method	limit/base	current	history 1	history 2
Acid Number (AN)	mg KOH/g ASTM D8045	1.0	0.43	0.345	0.375


OIL ANALYSIS REPORT

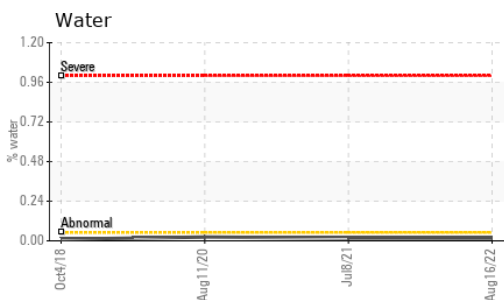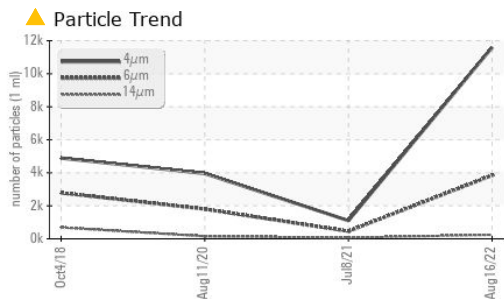






PARAMETER	method	limit/base	current	history 1	history 2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	VLITE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history 1	history 2
Visc @ 40°C	cSt	ASTM D445	45	49.4	47.7

SAMPLE IMAGES	method	limit/base	current	history 1	history 2
---------------	--------	------------	---------	-----------	-----------

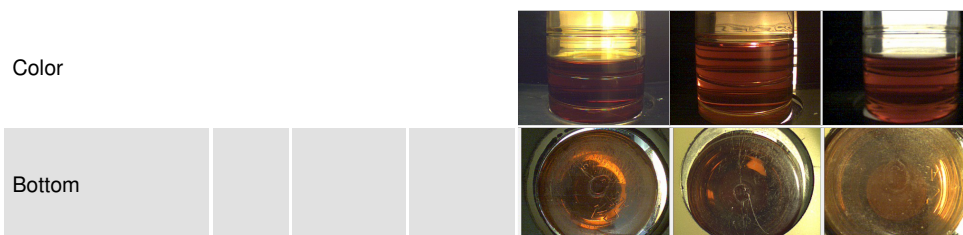

GRAPHS

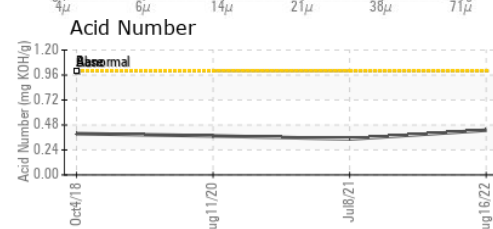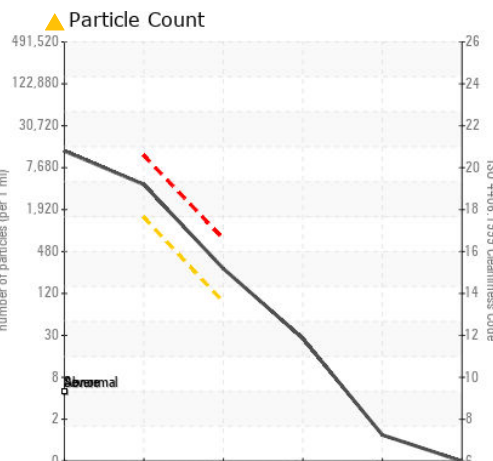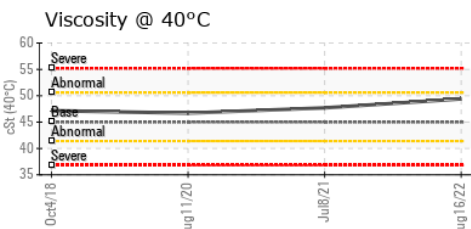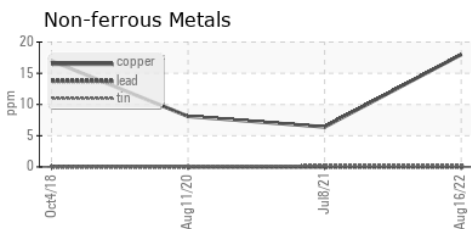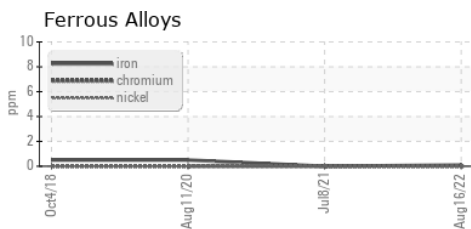

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : KCP49362 **Received** : 06 Sep 2022
Lab Number : 05635050 **Diagnosed** : 08 Sep 2022
Unique Number : 10124580 **Diagnostician** : Don Baldrige
Test Package : IND 2 (Additional Tests: KF, PrtCount)

CABINET MAX CORP
 1717 WHITEHEAD RD
 BALTIMORE, MD
 USA 21207
 Contact: Service Manager

To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)