


# **PROBLEM SUMMARY**

Sample Rating Trend




KAESER 7032922

Component

Compressor

KAESER SIGMA (OEM) M-460 (--- GAL)

# **COMPONENT CONDITION SUMMARY**

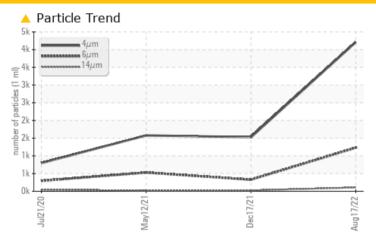

## RECOMMENDATION

Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

PROBLEMATIC TEST RESULTS							
Sample Status			ATTENTION	NORMAL	NORMAL		
Particles >14μm	ASTM D7647	>80	<b>107</b>	25	22		
Particles >21µm	ASTM D7647	>20	<b>22</b>	8	5		
Oil Cleanliness	ISO 4406 (c)	>/17/13	<b>19/17/14</b>	16/12	16/12		

Customer Id: NAWSTI Sample No.: KCP48285 Lab Number: 05635054 Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:

Don Baldridge +1 don.b505@comcast.net

To change component or sample information: Customer Service +1 1-800-237-1369 customerservice@wearcheck.com

### **RECOMMENDED ACTIONS**

Action	Status	Date	Done By	Description
Change Fluid			?	Oil and filter change at the time of sampling has been noted.
Change Filter			?	Oil and filter change at the time of sampling has been noted.

## HISTORICAL DIAGNOSIS

### 17 Dec 2021 Diag: Don Baldridge

#### NORMAL



Resample at the next service interval to monitor. All component wear rates are normal. The amount and size of particulates present in the system are acceptable. There is no indication of any contamination in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.



## 12 May 2021 Diag: Doug Bogart

#### NORMAL



No corrective action is recommended at this time. Resample at the next service interval to monitor. All component wear rates are normal. The amount and size of particulates present in the system are acceptable. There is no indication of any contamination in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

# view report

## 21 Jul 2020 Diag: Angela Borella

#### NORMAL




No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor. All component wear rates are normal. The amount and size of particulates present in the system are acceptable. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.





# **OIL ANALYSIS REPORT**

Sample Rating Trend



ISO

Machine Id

# **KAESER 7032922**

Component

Compressor

KAESER SIGMA (OEM) M-460 (--- GAL)

# DIAGNOSIS

### Recommendation

Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

#### Wear

All component wear rates are normal.

# Contamination

There is a moderate amount of particulates present in the oil.

### **Fluid Condition**

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.


		Jul2020	May2021	Dec2021 Au	ıg2022	
SAMPLE INFORM	MATION	method	limit/base	current	history 1	history 2
Sample Number				KCP48285	KCP43148	KCP32066
Sample Date				17 Aug 2022	17 Dec 2021	12 May 2021
Machine Age	hrs			9534	7101	4532
Oil Age	hrs			2433	2569	4532
Oil Changed				Changed	Changed	N/A
Sample Status				ATTENTION	NORMAL	NORMAL
WEAR METALS		method	limit/base	current	history 1	history 2
Iron	ppm	ASTM D5185m	>50	<1	<1	<1
Chromium	ppm	ASTM D5185m	>10	0	0	0
Nickel	ppm	ASTM D5185m	>3	0	0	0
Titanium	ppm	ASTM D5185m	>3	0	0	0
Silver	ppm	ASTM D5185m	>2	0	0	0
Aluminum	ppm	ASTM D5185m	>10	<1	<1	<1
Lead	ppm	ASTM D5185m	>10	0	0	0
Copper	ppm	ASTM D5185m	>50	2	4	7
Tin	ppm	ASTM D5185m	>10	0	0	0
Antimony	ppm	ASTM D5185m			0	0
Vanadium	ppm	ASTM D5185m		0	0	0
Cadmium	ppm	ASTM D5185m		0	0	0
ADDITIVES		method	limit/base	current	history 1	history 2
Boron	ppm	ASTM D5185m	0	2	0	11
Barium	ppm	ASTM D5185m	90	0	<1	0
Molybdenum	ppm	ASTM D5185m	0	0	0	0
Manganese	ppm	ASTM D5185m		0	0	0
Magnesium	ppm	ASTM D5185m	100	30	27	4
Calcium	ppm	ASTM D5185m	0	0	0	0
Phosphorus	ppm	ASTM D5185m	0	2	2	4
Zinc	ppm	ASTM D5185m	0	17	28	3
Sulfur	ppm	ASTM D5185m	23500	18765	16915	16301
CONTAMINANTS	;	method	limit/base	current	history 1	history 2
Silicon	ppm	ASTM D5185m	>25	0	0	0
Sodium	ppm	ASTM D5185m		10	10	2
Potassium	ppm	ASTM D5185m	>20	2	2	<1
Water	%	ASTM D6304	>0.05	0.023	0.008	0.006
ppm Water	ppm	ASTM D6304	>500	237.7	86.1	67.8
FLUID CLEANLIN	IESS	method	limit/base	current	history 1	history 2
Particles >4µm		ASTM D7647		4210	1527	1578
Particles >6µm		ASTM D7647	>1300	1231	328	529
Particles >14μm		ASTM D7647	>80	<u> </u>	25	22
Particles >21µm		ASTM D7647	>20	<u>^</u> 22	8	5
Particles >38μm		ASTM D7647	>4	1	1	0
Particles >71μm		ASTM D7647	>3	0	0	0
Oil Cleanliness		ISO 4406 (c)	>/17/13	<b>19/17/14</b>	16/12	16/12
FLUID DEGRADA	TION	method	limit/base	current	history 1	history 2
			4.0		0.44	

0.44


0.388



# **OIL ANALYSIS REPORT**



VISUAL		method	limit/base	current	history 1	history 2
White Metal	scalar	*Visual	NONE	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML	NORML
<b>Emulsified Water</b>	scalar	*Visual	>0.05	NEG	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG	NEG
FLUID PROPERTIES		method	limit/base	current	history 1	history 2
Visc @ 40°C	cSt	ASTM D445	45	47.5	47.4	44.8
SAMPLE IMAGES		method	limit/base	current	history 1	history 2
Color						
Bottom						

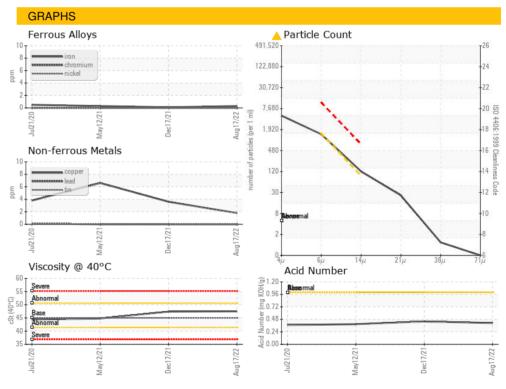





Laboratory Sample No. Lab Number Unique Number : 10124584

: 05635054

: WearCheck USA - 501 Madison Ave., Cary, NC 27513 : KCP48285

Received Diagnosed

: 06 Sep 2022 : 08 Sep 2022 Diagnostician : Don Baldridge

17454 WEBSTER FIELD RD ST INIGOES, MD USA 20684

Contact: Service Manager

Test Package : IND 2 ( Additional Tests: KF, PrtCount ) To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

**NAWCAD** 

T:

F: