

PROBLEM SUMMARY

Sample Rating Trend

ISO


Machine Id **5698065 (S/N 1285)**

Component

Compressor

KAESER SIGMA (OEM) S-460 (--- GAL)

COMPONENT CONDITION SUMMARY

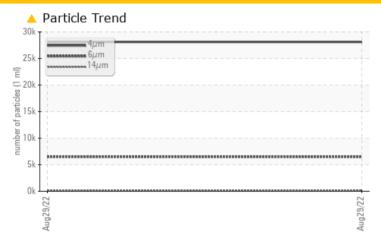

RECOMMENDATION

Oil and filter change at the time of sampling has been noted. No corrective action is recommended at this time. Resample at the next service interval to monitor.

PROBLEMATIC TES	ST RESULTS			
Sample Status			ABNORMAL	
Particles >6µm	ASTM D7647	>1300	△ 6497	
Particles >14µm	ASTM D7647	>80	204	
Particles >21µm	ASTM D7647	>20	△ 38	
Oil Cleanliness	ISO 4406 (c)	>/17/13	22/20/15	

Customer Id: GROTERCA Sample No.: KCP28678 Lab Number: 05635067 Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:

Don Baldridge +1 don.b505@comcast.net

To change component or sample information: Customer Service +1 1-800-237-1369 customerservice@wearcheck.com

RECOMMENDE	O ACTIONS			
Action	Status	Date	Done By	Description
Change Fluid			?	Oil and filter change at the time of sampling has been noted.
Change Filter			?	Oil and filter change at the time of sampling has been noted.

HISTORICAL DIAGNOSIS



OIL ANALYSIS REPORT

Sample Rating Trend

ISO

5698065 (S/N 1285)

KAESER SIGMA (OEM) S-460 (--- GAL)

Compressor

D	IA	GI	N	O	S	IS
	٠, ١	<u> </u>		v	0	\cdot

Recommendation

Oil and filter change at the time of sampling has been noted. No corrective action is recommended at this time. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is a high amount of particulates present in the oil.


Fluid Condition


The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

				Aug2022		
SAMPLE INFORM	MATION	method	limit/base	current	history 1	history 2
Sample Number				KCP28678		
Sample Date				29 Aug 2022		
Machine Age	hrs			20846		
Oil Age	hrs			2000		
Oil Changed				Changed		
Sample Status				ABNORMAL		
WEAR METALS		method	limit/base	current	history 1	history 2
Iron	ppm	ASTM D5185m	>50	<1		
Chromium	ppm	ASTM D5185m	>10	0		
Nickel	ppm	ASTM D5185m	>3	0		
Titanium	ppm	ASTM D5185m	>3	0		
Silver	ppm	ASTM D5185m	>2	0		
Aluminum	ppm	ASTM D5185m	>10	0		
Lead	ppm	ASTM D5185m	>10	0		
Copper	ppm	ASTM D5185m	>50	23		
Tin	ppm	ASTM D5185m	>10	0		
Vanadium	ppm	ASTM D5185m	>10	0		
Cadmium	ppm	ASTM D5185m		0		
	ррпп			Ū		
ADDITIVES		method	limit/base	current	history 1	history 2
Boron	ppm	ASTM D5185m		0		
Barium	ppm	ASTM D5185m	90	0		
Molybdenum	ppm	ASTM D5185m		0		
Manganese	ppm	ASTM D5185m		0		
Magnesium	ppm	ASTM D5185m	90	1		
Calcium	ppm	ASTM D5185m	2	0		
Phosphorus	ppm	ASTM D5185m		5		
Zinc	ppm	ASTM D5185m		68		
Sulfur	ppm	ASTM D5185m		15501		
CONTAMINANTS	3	method	limit/base	current	history 1	history 2
Silicon	ppm	ASTM D5185m	>25	<1		
Sodium	ppm	ASTM D5185m		5		
Potassium	ppm	ASTM D5185m	>20	0		
Water	%	ASTM D6304	>0.05	0.010		
ppm Water	ppm	ASTM D6304	>500	101.5		
FLUID CLEANLIN	IESS	method	limit/base	current	history 1	history 2
Particles >4µm		ASTM D7647		28109		
Particles >6µm		ASTM D7647	>1300	4 6497		
Particles >14µm		ASTM D7647	>80	<u>^</u> 204		
Particles >21µm		ASTM D7647	>20	<u> </u>		
Particles >38µm		ASTM D7647	>4	2		
Particles >71µm		ASTM D7647	>3	1		
Oil Cleanliness		ISO 4406 (c)	>/17/13	<u>^</u> 22/20/15		
FLUID DEGRADA	MOITA	method	limit/base		history 1	history 2
				current	history 1	HISTORY Z
Acid Number (AN)	mg KOH/g	ASTM D8045	0.4	0.36		



OIL ANALYSIS REPORT

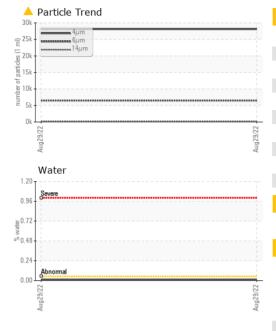

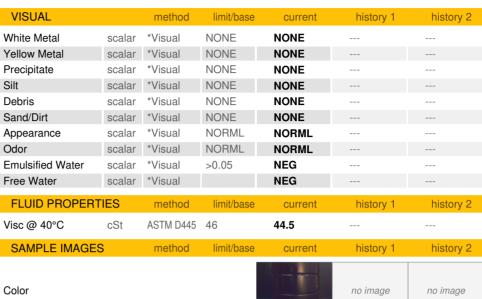

Ferrous Alloys	A Particle Count	
iron	491,520	
BREEFREERE CHROMIUM	122,880	
	30,720	
	7.000	
222	7,680 2 E	
Aug29/22	Nug 29/22 s (per 1 ml	
Non-ferrous Metals	180 480	
copper	Aug29/22 number of particles (par 1 m) 120	
seeseeseese [ead		
	30 -	
	8 Sibrese mal	
3/22	2-	
Aug29/22	Aug29/22	
Viscosity @ 40°C	$^{74}\!\mu$ $^{6}\!\mu$ $^{14}\!\mu$ Acid Number	21μ 38μ 71
Abnormal		
Base	Q 0.40 + Bases	
Abd	Base Bull 0.30 Bull 0.30 Bull 0.30 Bull 0.30	
Abnormal	₹ 0.10 -	
Aug29/22	Aug29/22 Aug29/22	





Certificate L2367

Laboratory Sample No. Lab Number Unique Number

: 05635067 : 10124597

Bottom

: KCP28678

Received Diagnosed

: 06 Sep 2022 : 08 Sep 2022 Diagnostician : Don Baldridge

Test Package : IND 2 (Additional Tests: KF, PrtCount)

To discuss this sample report, contact Customer Service at 1-800-237-1369. * - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Contact: Service Manager

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

no image

no image

23590 AVE 95

USA 93270

T: F:

TERRA BELLA, CA