

PROBLEM SUMMARY

Sample Rating Trend

ISO


KAESER 7868654

Component

Compressor

NOT GIVEN (--- GAL)

COMPONENT CONDITION SUMMARY

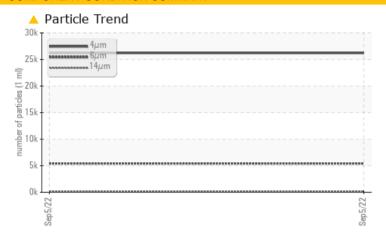

RECOMMENDATION

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor. (dirt at bottom of sample due to a dirty sample drain).

PROBLEMATIC TES	T RESULTS			
Sample Status			ABNORMAL	
Particles >6µm	ASTM D7647	>1300	△ 5423	
Particles >14μm	ASTM D7647	>80	168	
Particles >21µm	ASTM D7647	>20	<u> </u>	
Oil Cleanliness	ISO 4406 (c)	>/17/13	22/20/15	

Customer Id: AMAPENNJ Sample No.: KCP41405 Lab Number: 05635089 Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:

Don Baldridge +1 don.b505@comcast.net

To change component or sample information: Customer Service +1 1-800-237-1369 customerservice@wearcheck.com

RECOMMENDED ACTIONS

There are no recommended actions for this sample.

HISTORICAL DIAGNOSIS



OIL ANALYSIS REPORT

Sample Rating Trend

ISO

Machina Id

KAESER 7868654

Component

Compressor

NOT GIVEN (--- GAL)

DIAGNOSIS

Recommendation

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor. (dirt at bottom of sample due to a dirty sample drain).

Wear

All component wear rates are normal.

Contamination

There is a high amount of particulates present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

		_				
				Sep 2022		
SAMPLE INFOR	MATION	method	limit/base	current	history 1	history 2
Sample Number				KCP41405		
Sample Date				05 Sep 2022		
Machine Age	hrs			1366		
Oil Age	hrs			1366		
Oil Changed				Not Changd		
Sample Status				ABNORMAL		
WEAR METALS		method	limit/base	current	history 1	history 2
Iron	ppm	ASTM D5185m	>50	<1		
Chromium	ppm	ASTM D5185m	>10	0		
Nickel	ppm	ASTM D5185m	>3	0		
Titanium	ppm	ASTM D5185m	>3	0		
Silver	ppm	ASTM D5185m	>2	0		
Aluminum	ppm	ASTM D5185m	>10	<1		
Lead	ppm	ASTM D5185m	>10	0		
Copper	ppm	ASTM D5185m	>50	2		
Tin	ppm	ASTM D5185m	>10	0		
Vanadium	ppm	ASTM D5185m		0		
Cadmium	ppm	ASTM D5185m		0		
ADDITIVES		method	limit/base	current	history 1	history 2
Boron	ppm	ASTM D5185m		0		
Barium	ppm	ASTM D5185m		6		
Molybdenum	ppm	ASTM D5185m		0		
Manganese	ppm	ASTM D5185m		<1		
Magnesium	ppm	ASTM D5185m		60		
Calcium	ppm	ASTM D5185m		2		
Phosphorus	ppm	ASTM D5185m		2		
Zinc	ppm	ASTM D5185m		3		
Sulfur	ppm	ASTM D5185m		15814		
CONTAMINANTS	3	method	limit/base	current	history 1	history 2
Silicon	ppm	ASTM D5185m	>25	0		
Sodium	ppm	ASTM D5185m		15		
Potassium	ppm	ASTM D5185m	>20	7		
Water	%	ASTM D6304	>0.05	0.038		
ppm Water	ppm	ASTM D6304	>500	380.1		
FLUID CLEANLIN	NESS	method	limit/base	current	history 1	history 2
Particles >4μm		ASTM D7647		26223		
Particles >6µm		ASTM D7647	>1300	△ 5423		

ASTM D7647 >80

ASTM D7647 >20

ASTM D7647 >4

ASTM D7647 >3

ISO 4406 (c)

method

mg KOH/g ASTM D8045

168

21

1

1

0.34

current

>--/17/13 **A 22/20/15**

limit/base

Particles >14µm

Particles >21µm

Particles >38µm

Particles >71µm

Oil Cleanliness

Acid Number (AN)


FLUID DEGRADATION


history 1

history 2



OIL ANALYSIS REPORT

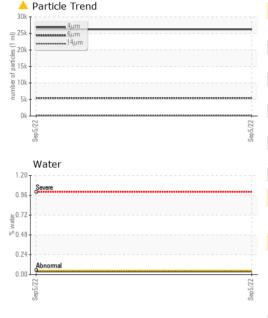

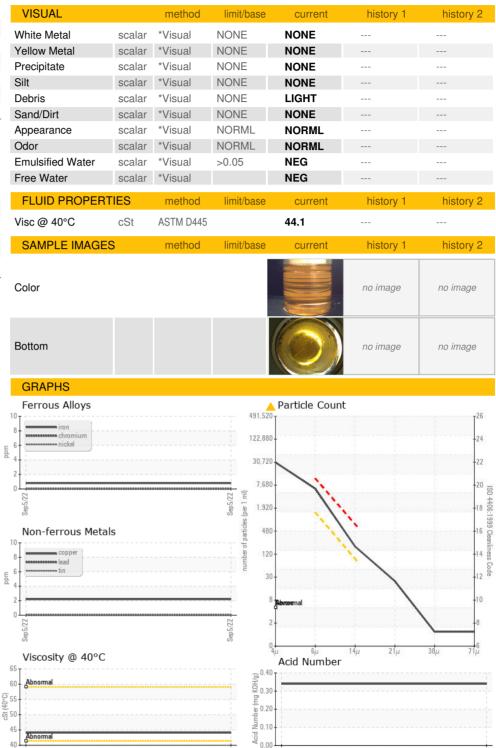





Certificate L2367

Laboratory Sample No. Lab Number **Unique Number**

: 05635089 : 10124619

: KCP41405

: WearCheck USA - 501 Madison Ave., Cary, NC 27513 Received : 06 Sep 2022 Diagnosed

: 08 Sep 2022 Diagnostician : Don Baldridge

Test Package : IND 2 (Additional Tests: KF, PrtCount) To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

AMAZON SERVICES LLC TEBY

747 COURSES RD PENS GROVE, NJ USA 08069

Contact: Service Manager

T: F:

Report Id: AMAPENNJ [WUSCAR] 05635089 (Generated: 09/08/2022 19:37:07)

Contact/Location: Service Manager - AMAPENNJ