

PROBLEM SUMMARY

Sample Rating Trend



Machine Id


KAESER ASD 25 1981324 (S/N 1071)

Component

Compressor

KAESER SIGMA (OEM) S-460 (--- GAL)

COMPONENT CONDITION SUMMARY

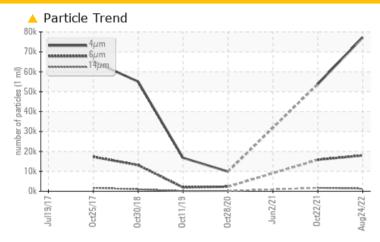

RECOMMENDATION

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

PROBLEMATIC TEST RESULTS								
Sample Status			ABNORMAL	ABNORMAL	ABNORMAL			
Particles >6μm	ASTM D7647	>1300	17973	<u>▲</u> 15813				
Particles >14μm	ASTM D7647	>80	1297	<u> </u>				
Particles >21µm	ASTM D7647	>20	168	476				
Oil Cleanliness	ISO 4406 (c)	>/17/13	23/21/17	<u> </u>				

Customer Id: BRELAM Sample No.: KC102926 Lab Number: 05636557 Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:

Don Baldridge +1 don.b505@comcast.net

To change component or sample information: Customer Service +1 1-800-237-1369 customerservice@wearcheck.com

RECOMMENDED ACTIONS

There are no recommended actions for this sample.

HISTORICAL DIAGNOSIS

22 Oct 2021 Diag: Don Baldridge

ISO



No corrective action is recommended at this time. Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor. All component wear rates are normal. There is a high amount of particulates present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.



02 Jun 2021 Diag: Jonathan Hester

VIS DEBRIS



Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor. We were unable to perform a particle count due to a high concentration of particles present in this sample.All component wear rates are normal. Moderate concentration of visible dirt/debris present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.



28 Oct 2020 Diag: Angela Borella

ISO




Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor.All component wear rates are normal. There is a high amount of particulates present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.





OIL ANALYSIS REPORT

Sample Rating Trend



KAESER ASD 25 1981324 (S/N 1071)

Compressor

KAESER SIGMA (OEM) S-460 (--- GAL)

DIAGNOSIS

Recommendation

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is a high amount of particulates present in the oil.


Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.


		Jul2017 (Oct2017 Oct2018 Oct201	9 Oct2020 Jun2021 Oct2021	Aug2022	
SAMPLE INFORM	MATION	method	limit/base	current	history 1	history 2
Sample Number				KC102926	KC92780	KC92784
Sample Date				24 Aug 2022	22 Oct 2021	02 Jun 2021
Machine Age	hrs			108741	103610	100943
Oil Age	hrs			2899	2667	3937
Oil Changed				Not Changd	Changed	Changed
Sample Status				ABNORMAL	ABNORMAL	ABNORMAL
WEAR METALS		method	limit/base	current	history 1	history 2
Iron	ppm	ASTM D5185m	>50	0	0	<1
Chromium	ppm	ASTM D5185m	>10	0	0	0
Nickel	ppm	ASTM D5185m	>3	0	0	<1
Titanium	ppm	ASTM D5185m	>3	0	<1	<1
Silver	ppm	ASTM D5185m	>2	0	<1	<1
Aluminum	ppm	ASTM D5185m	>10	0	0	<1
Lead	ppm	ASTM D5185m	>10	0	<1	<1
Copper	ppm	ASTM D5185m	>50	10	13	9
Tin	ppm	ASTM D5185m	>10	0	<1	<1
Antimony	ppm	ASTM D5185m			0	<1
Vanadium	ppm	ASTM D5185m		0	0	0
Cadmium	ppm	ASTM D5185m		0	0	0
ADDITIVES		method	limit/base	current	history 1	history 2
Boron	ppm	ASTM D5185m		0	0	13
Barium	ppm	ASTM D5185m	90	0	0	0
Molybdenum	ppm	ASTM D5185m		0	0	<1
Manganese	ppm	ASTM D5185m		0	0	0
Magnesium	ppm	ASTM D5185m	90	0	1	2
Calcium	ppm	ASTM D5185m	2	0	0	0
Phosphorus	ppm	ASTM D5185m		3	1	6
Zinc	ppm	ASTM D5185m		0	0	18
CONTAMINANTS		method	limit/base	current	history 1	history 2
Silicon	ppm	ASTM D5185m	>25	0	0	2
Sodium	ppm	ASTM D5185m		<1	0	1
Potassium	ppm	ASTM D5185m	>20	0	0	<1
Water	%	ASTM D6304	>0.05	0.011	0.004	0.019
ppm Water	ppm	ASTM D6304	>500	117.7	47.7	191.8
FLUID CLEANLIN	IESS	method	limit/base	current	history 1	history 2
Particles >4μm		ASTM D7647		77228	53795	
Particles >6µm		ASTM D7647		<u> </u>	<u>▲</u> 15813	
Particles >14μm		ASTM D7647	>80	<u>1297</u>	<u>▲</u> 1721	
Particles >21µm		ASTM D7647	>20	<u>^</u> 168	<u>476</u>	
		ASTM D7647	>4	3	<u>41</u>	
Particles >38µm						
Particles >71µm		ASTM D7647	>3	1	2	
			>3 >/17/13	1 23/21/17	2 ^ 21/18	
Particles >71µm	TION	ASTM D7647				



OIL ANALYSIS REPORT



VISUAL		method	limit/base	current	history 1	history 2
White Metal	scalar	*Visual	NONE	LIGHT	LIGHT	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	LIGHT	LIGHT	▲ MODER
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG	NEG
FLUID PROPERT	ΓIES	method	limit/base	current	history 1	history 2
Visc @ 40°C	cSt	ASTM D445	46	43.9	44.0	44.5
SAMPLE IMAGE	S	method	limit/base	current	history 1	history 2
Color						
Bottom						

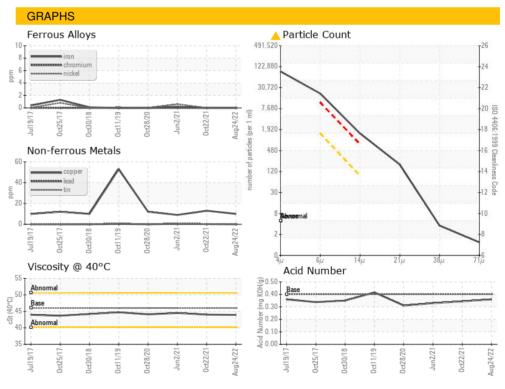



Certificate L2367

Laboratory Sample No. Lab Number

: KC102926 : 05636557 Unique Number : 10126087 Test Package : IND 2

: WearCheck USA - 501 Madison Ave., Cary, NC 27513 Received Diagnosed

: 08 Sep 2022 : 09 Sep 2022 Diagnostician : Don Baldridge

BREEN COLOR 11 KARI DR LAMBERTVILLE, NJ USA 08530

Contact:

T:

F:

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)