

PROBLEM SUMMARY


Sample Rating Trend

ISO

KAESER SFC 22ST 6593559 (S/N 1009)


Compressor

KAESER SIGMA (OEM) M-460 (--- GAL)





COMPONENT CONDITION SUMMARY

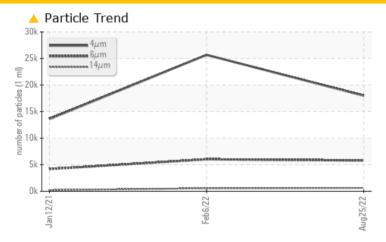

RECOMMENDATION

Oil and filter change at the time of sampling has been noted. No corrective action is recommended at this time. Resample at the next service interval to monitor.

PROBLEMATIC TEST RESULTS							
Sample Status		ABNORMA	L ABNORMAL	ABNORMAL			
Particles >6µm	ASTM D7647 >1	300 4 5803	<u></u> 6020	△ 4180			
Particles >14µm	ASTM D7647 >8	0 🔺 626	<u></u> 561	<u>^</u> 205			
Particles >21µm	ASTM D7647 >2	0 209	<u> 142</u>	4 8			
Particles >38µm	ASTM D7647 >4	<u> </u>	2	2			
Oil Cleanliness	ISO 4406 (c) >	/17/13 🛕 21/20/16	<u>^</u> 20/16	1 9/15			

Customer Id: ACCSOM Sample No.: KC102902 Lab Number: 05636572 Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:

Don Baldridge +1 don.b505@comcast.net

To change component or sample information: Customer Service +1 1-800-237-1369 customerservice@wearcheck.com

RECOMMENDED ACTIONS

Action	Status	Date	Done By	Description
Change Fluid			?	Oil and filter change at the time of sampling has been noted.
Change Filter			?	Oil and filter change at the time of sampling has been noted.

HISTORICAL DIAGNOSIS

06 Feb 2022 Diag: Doug Bogart





Oil and filter change at the time of sampling has been noted. No corrective action is recommended at this time. Resample at the next service interval to monitor. All component wear rates are normal. There is a high amount of particulates present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.



12 Jan 2021 Diag: Jonathan Hester

ISO




Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor. All component wear rates are normal. There is a high amount of particulates present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.





OIL ANALYSIS REPORT

Sample Rating Trend



KAESER SFC 22ST 6593559 (S/N 1009)

Compressor

KAESER SIGMA (OEM) M-460 (--- GAL)

DIAGNOSIS

Recommendation

Oil and filter change at the time of sampling has been noted. No corrective action is recommended at this time. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is a high amount of particulates present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

		Jar	2021	Feb2022 Aug21	122	
SAMPLE INFORM	MATION	method	limit/base	current	history 1	history 2
Sample Number				KC102902	KC96856	KC92303
Sample Date				25 Aug 2022	06 Feb 2022	12 Jan 2021
Machine Age	hrs			6092	4672	2076
Oil Age	hrs			4016	2596	2076
Oil Changed				Changed	Changed	Changed
Sample Status				ABNORMAL	ABNORMAL	ABNORMAL
WEAR METALS		method	limit/base	current	history 1	history 2
Iron	ppm	ASTM D5185m	>50	0	1	<1
Chromium	ppm	ASTM D5185m	>10	0	0	0
Nickel	ppm	ASTM D5185m	>3	0	0	0
Titanium	ppm	ASTM D5185m	>3	0	0	0
Silver	ppm	ASTM D5185m	>2	0	0	0
Aluminum	ppm	ASTM D5185m	>10	<1	3	<1
Lead	ppm	ASTM D5185m	>10	0	<1	<1
Copper	ppm	ASTM D5185m	>50	5	3	4
Tin	ppm	ASTM D5185m	>10	0	0	0
Antimony	ppm	ASTM D5185m			<1	0
Vanadium	ppm	ASTM D5185m		0	0	0
Cadmium	ppm	ASTM D5185m		0	0	0
ADDITIVES		method	limit/base	current	history 1	history 2
Boron	ppm	ASTM D5185m	0	0	<1	10
Barium	ppm	ASTM D5185m	90	0	1	0
Molybdenum	ppm	ASTM D5185m	0	0	0	0
Manganese	ppm	ASTM D5185m		0	<1	<1
Magnesium	ppm	ASTM D5185m	100	44	71	72
Calcium	ppm	ASTM D5185m	0	0	<1	1
Phosphorus	ppm	ASTM D5185m	0	2	6	2
Zinc	ppm	ASTM D5185m	0	9	0	8
CONTAMINANTS	1	method	limit/base	current	history 1	history 2
Silicon	ppm	ASTM D5185m	>25	<1	<1	<1
Sodium	ppm	ASTM D5185m		12	21	25
Potassium	ppm	ASTM D5185m	>20	0	3	3
Water	%	ASTM D6304	>0.05	0.025	0.018	0.025
ppm Water	ppm	ASTM D6304	>500	253.4	181.1	250.0
FLUID CLEANLIN	IESS	method	limit/base	current	history 1	history 2
Particles >4µm		ASTM D7647		18007	25684	13596
Particles >6µm		ASTM D7647	>1300	△ 5803	▲ 6020	<u></u> 4180
Particles >14µm		ASTM D7647	>80	626	<u></u> ▲ 561	<u>^</u> 205
Particles >21µm		ASTM D7647	>20	<u>^</u> 209	<u>▲</u> 142	▲ 48
Particles >38µm		ASTM D7647	>4	<u> </u>	2	2
Particles >71µm		ASTM D7647	>3	0	0	0
Oil Cleanliness		ISO 4406 (c)	>/17/13	21/20/16	2 0/16	△ 19/15
FLUID DEGRADA	TION	method	limit/base	current	history 1	history 2
		ASTM D8045		0.39	0.40	0.317

Acid Number (AN)

mg KOH/g ASTM D8045 1.0


0.39

0.40


0.317



OIL ANALYSIS REPORT

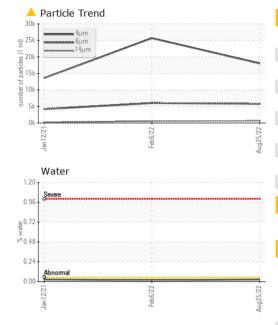

VISUAL		method	limit/base	ourront	hiotony 1	hiotony 2
VISUAL		method	IIIIII/base	current	history 1	history 2
White Metal	scalar	*Visual	NONE	LIGHT	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	VLITE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG	NEG
FLUID PROPERT	IES	method	limit/base	current	history 1	history 2
Visc @ 40°C	cSt	ASTM D445	45	48.3	44.3	43.7
SAMPLE IMAGES	3	method	limit/base	current	history 1	history 2
Color						
Bottom						

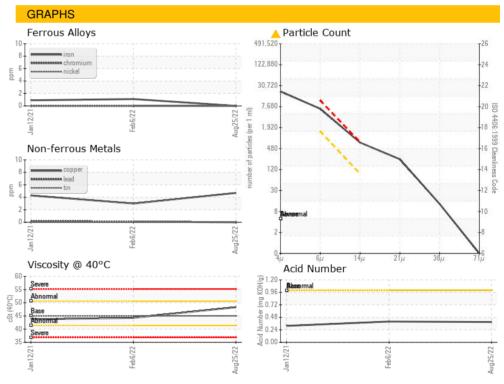



Certificate L2367

Laboratory Sample No. Lab Number

Unique Number : 10126102 Test Package : IND 2

: KC102902 : 05636572

: WearCheck USA - 501 Madison Ave., Cary, NC 27513 Received Diagnosed

: 08 Sep 2022 : 12 Sep 2022 Diagnostician : Don Baldridge

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

ACCESS BIO 65 CLYDE RD SOMERSET, NJ USA 08873 Contact:

T:

F:

Contact/Location: ? ? - ACCSOM