

PROBLEM SUMMARY

Sample Rating Trend

ISO


Machine Id **6989379 (S/N 1266)**

Component

Compressor

KAESER SIGMA (OEM) S-460 (--- GAL)

COMPONENT CONDITION SUMMARY

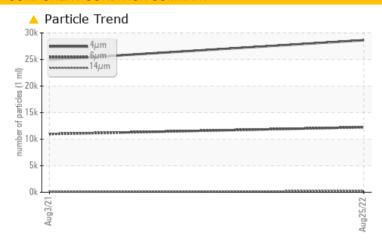

RECOMMENDATION

No corrective action is recommended at this time. Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

PROBLEMATIC TEST RESULTS									
Sample Status			ABNORMAL	ABNORMAL					
Particles >6µm	ASTM D7647	>1300	12244	<u>▲</u> 10957					
Particles >14μm	ASTM D7647	>80	241	<u>134</u>					
Particles >21µm	ASTM D7647	>20	△ 30	5					
Oil Cleanliness	ISO 4406 (c)	>/17/13	22/21/15	<u>^</u> 21/14					

Customer Id: NORIND Sample No.: KC83012 Lab Number: 05637140 Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data: Doug Bogart +1 (800)237-1369 x4016 dougb@wearcheckusa.com

To change component or sample information: Customer Service +1 1-800-237-1369 customerservice@wearcheck.com

RECOMMENDED ACTIONS							
Action	Status	Date	Done By	Description			
Change Fluid			?	Oil and filter change at the time of sampling has been noted.			
Change Filter			?	Oil and filter change at the time of sampling has been noted.			

HISTORICAL DIAGNOSIS

03 Aug 2021 Diag: Angela Borella






Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor. All component wear rates are normal. There is a moderate amount of particulates present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.





OIL ANALYSIS REPORT

Sample Rating Trend



ISO

6989379 (S/N 1266)

Compressor

KAESER SIGMA (OEM) S-460 (--- GAL)

DIAGNOSIS

Recommendation

No corrective action is recommended at this time. Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is a high amount of particulates present in the oil.


Fluid Condition


The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

			Aug2021	Aug2022		
SAMPLE INFORM	MATION	method	limit/base	current	history 1	history 2
Sample Number				KC83012	KC98194	
Sample Date				25 Aug 2022	03 Aug 2021	
Machine Age	hrs			1409	756	
Oil Age	hrs			553	382	
Oil Changed				Changed	Changed	
Sample Status				ABNORMAL	ABNORMAL	
WEAR METALS		method	limit/base	current	history 1	history 2
Iron	ppm	ASTM D5185m	>50	0	0	
Chromium	ppm	ASTM D5185m	>10	0	0	
Nickel	ppm	ASTM D5185m	>3	0	0	
Titanium	ppm	ASTM D5185m	>3	0	0	
Silver	ppm	ASTM D5185m	>2	0	0	
Aluminum	ppm	ASTM D5185m	>10	<1	<1	
Lead	ppm	ASTM D5185m	>10	0	0	
Copper	ppm	ASTM D5185m	>50	<1	<1	
Tin	ppm	ASTM D5185m	>10	0	0	
Antimony	ppm	ASTM D5185m			0	
Vanadium	ppm	ASTM D5185m		0	0	
Cadmium	ppm	ASTM D5185m		0	0	
ADDITIVES		method	limit/base	current	history 1	history 2
Boron	ppm	ASTM D5185m		0	13	
Barium	ppm	ASTM D5185m	90	24	22	
Molybdenum	ppm	ASTM D5185m		0	0	
Manganese	ppm	ASTM D5185m		0	<1	
Magnesium	ppm	ASTM D5185m	90	73	67	
Calcium	ppm	ASTM D5185m	2	0	0	
Phosphorus	ppm	ASTM D5185m		<1	1	
Zinc	ppm	ASTM D5185m		<1	1	
CONTAMINANTS		method	limit/base	current	history 1	history 2
Silicon	ppm	ASTM D5185m	>25	0	0	
Sodium	ppm	ASTM D5185m		10	9	
Potassium	ppm	ASTM D5185m	>20	<1	2	
Water	%	ASTM D6304	>0.05	0.030	0.029	
ppm Water	ppm	ASTM D6304	>500	308.8	291.1	
FLUID CLEANLIN	IESS	method	limit/base	current	history 1	history 2
Particles >4μm		ASTM D7647		28633	24958	
Particles >6μm		ASTM D7647	>1300	<u> </u>	<u>▲</u> 10957	
Particles >14μm		ASTM D7647	>80	<u>^</u> 241	<u> </u>	
Particles >21μm		ASTM D7647		<u>^</u> 30	5	
Particles >38μm		ASTM D7647	>4	1	0	
Particles >71μm		ASTM D7647		0	0	
Oil Cleanliness		ISO 4406 (c)	>/17/13	<u>22/21/15</u>	<u>^</u> 21/14	
FLUID DEGRADA	TION		12 25 0			
FLUID DEGRADA	TION	method	limit/base	current	history 1	history 2



OIL ANALYSIS REPORT

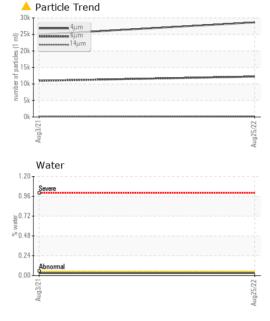

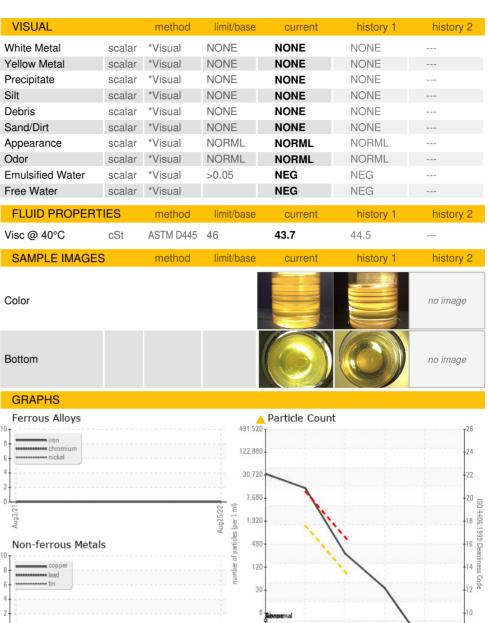





Certificate L2367

Laboratory Sample No. Lab Number **Unique Number** Test Package

: KC83012 : 05637140 : 10126670 : IND 2

Viscosity @ 40°C

: WearCheck USA - 501 Madison Ave., Cary, NC 27513 : 08 Sep 2022 Received Diagnosed Diagnostician

: 09 Sep 2022 : Doug Bogart

NORTHSIDE GLASS 7206 N KEYSTONE AVE INDIANAPOLIS, IN USA 46240

Contact: Service Manager

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

Acid Number

0.50 W 0.40 E 0.30 은 0.20 0.10 0.00

T: F: