

PROBLEM SUMMARY

Sample Rating Trend




ISO



Machine Id
KAESER AS 25 7953768 (S/N 1515)
Component
Compressor
Fluid
KAESER SIGMA (OEM) S-460 (--- LTR)

COMPONENT CONDITION SUMMARY

▲ Particle Trend

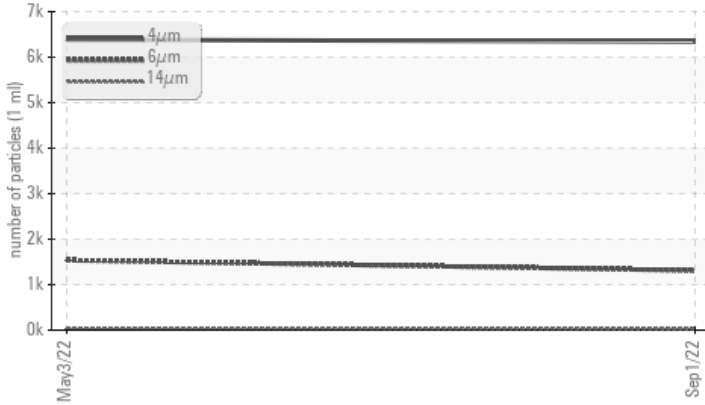

RECOMMENDATION

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

PROBLEMATIC TEST RESULTS

| Sample Status | | | ATTENTION | ATTENTION | --- |
|-----------------|--------------|-----------|------------|------------|-----|
| Particles >6µm | ASTM D7647 | >1300 | ▲ 1311 | ▲ 1537 | --- |
| Oil Cleanliness | ISO 4406 (c) | >--/17/13 | ▲ 20/18/12 | ▲ 20/18/13 | --- |

Customer Id: WALPENKC
Sample No.: KC05637684
Lab Number: 05637684
Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:
Jonathan Hester +1 919-379-4092 x4092
jhester@wearcheckusa.com

To change component or sample information:
Customer Service +1 1-800-237-1369
customerservice@wearcheck.com

RECOMMENDED ACTIONS

There are no recommended actions for this sample.

HISTORICAL DIAGNOSIS

03 May 2022 Diag: Don Baldrige

ISO



Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor. All component wear rates are normal. There is a moderate amount of silt (particulates < 14 microns in size) present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report






Machine Id
KAESER AS 25 7953768 (S/N 1515)

Component
Compressor

Fluid
KAESER SIGMA (OEM) S-460 (--- LTR)

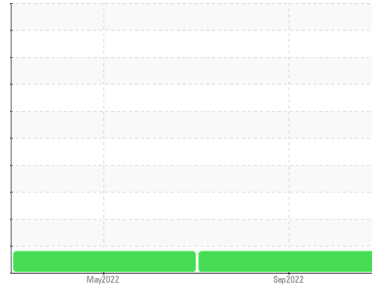

DIAGNOSIS

Recommendation

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is a moderate amount of silt (particulates < 14 microns in size) present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

| | method | limit/base | current | history 1 | history 2 |
|---------------|--------|------------|--------------------|-------------|-----------|
| Sample Number | | | KC05637684 | KC05543232 | --- |
| Sample Date | | | 01 Sep 2022 | 03 May 2022 | --- |
| Machine Age | hrs | | 0 | 4767 | --- |
| Oil Age | hrs | | 0 | 0 | --- |
| Oil Changed | | | N/A | Changed | --- |
| Sample Status | | | ATTENTION | ATTENTION | --- |

WEAR METALS

| | method | limit/base | current | history 1 | history 2 |
|----------|--------|-----------------|--------------|-----------|-----------|
| Iron | ppm | ASTM D5185m >50 | <1 | 1 | --- |
| Chromium | ppm | ASTM D5185m >10 | 0 | 0 | --- |
| Nickel | ppm | ASTM D5185m >3 | 0 | <1 | --- |
| Titanium | ppm | ASTM D5185m >3 | 0 | 0 | --- |
| Silver | ppm | ASTM D5185m >2 | <1 | <1 | --- |
| Aluminum | ppm | ASTM D5185m >10 | 0 | <1 | --- |
| Lead | ppm | ASTM D5185m >10 | 0 | <1 | --- |
| Copper | ppm | ASTM D5185m >50 | 2 | 3 | --- |
| Tin | ppm | ASTM D5185m >10 | <1 | <1 | --- |
| Vanadium | ppm | ASTM D5185m | 0 | 0 | --- |
| Cadmium | ppm | ASTM D5185m | 0 | 0 | --- |

ADDITIVES

| | method | limit/base | current | history 1 | history 2 |
|------------|--------|----------------|--------------|-----------|-----------|
| Boron | ppm | ASTM D5185m | 0 | <1 | --- |
| Barium | ppm | ASTM D5185m 90 | 56 | 57 | --- |
| Molybdenum | ppm | ASTM D5185m | 0 | 0 | --- |
| Manganese | ppm | ASTM D5185m | <1 | <1 | --- |
| Magnesium | ppm | ASTM D5185m 90 | 74 | 78 | --- |
| Calcium | ppm | ASTM D5185m 2 | 3 | 5 | --- |
| Phosphorus | ppm | ASTM D5185m | 0 | 8 | --- |
| Zinc | ppm | ASTM D5185m | 5 | 7 | --- |

CONTAMINANTS

| | method | limit/base | current | history 1 | history 2 |
|-----------|--------|------------------|--------------|-----------|-----------|
| Silicon | ppm | ASTM D5185m >25 | <1 | <1 | --- |
| Sodium | ppm | ASTM D5185m | 16 | 20 | --- |
| Potassium | ppm | ASTM D5185m >20 | 7 | 22 | --- |
| Water | % | ASTM D6304 >0.05 | 0.012 | 0.014 | --- |
| ppm Water | ppm | ASTM D6304 >500 | 123.6 | 149.6 | --- |


FLUID CLEANLINESS

| | method | limit/base | current | history 1 | history 2 |
|-----------------|------------------------|------------|-------------------|------------|-----------|
| Particles >4µm | ASTM D7647 | | 6342 | 6384 | --- |
| Particles >6µm | ASTM D7647 >1300 | | ▲ 1311 | ▲ 1537 | --- |
| Particles >14µm | ASTM D7647 >80 | | 28 | 49 | --- |
| Particles >21µm | ASTM D7647 >20 | | 3 | 8 | --- |
| Particles >38µm | ASTM D7647 >4 | | 0 | 1 | --- |
| Particles >71µm | ASTM D7647 >3 | | 0 | 0 | --- |
| Oil Cleanliness | ISO 4406 (c) >--/17/13 | | ▲ 20/18/12 | ▲ 20/18/13 | --- |

FLUID DEGRADATION



| | method | limit/base | current | history 1 | history 2 |
|------------------|---------------------|------------|-------------|-----------|-----------|
| Acid Number (AN) | mg KOH/g ASTM D8045 | 0.4 | 0.33 | 0.35 | --- |

OIL ANALYSIS REPORT





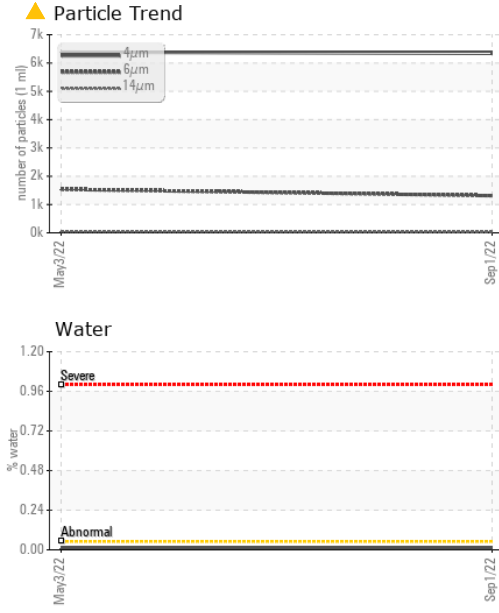


| VISUAL | method | limit/base | current | history 1 | history 2 | |
|------------------|--------|------------|---------|--------------|-----------|-----|
| White Metal | scalar | *Visual | NONE | MODER | NONE | --- |
| Yellow Metal | scalar | *Visual | NONE | NONE | NONE | --- |
| Precipitate | scalar | *Visual | NONE | NONE | NONE | --- |
| Silt | scalar | *Visual | NONE | NONE | NONE | --- |
| Debris | scalar | *Visual | NONE | NONE | NONE | --- |
| Sand/Dirt | scalar | *Visual | NONE | NONE | NONE | --- |
| Appearance | scalar | *Visual | NORML | NORML | NORML | --- |
| Odor | scalar | *Visual | NORML | NORML | NORML | --- |
| Emulsified Water | scalar | *Visual | >0.05 | NEG | NEG | --- |
| Free Water | scalar | *Visual | | NEG | NEG | --- |

| FLUID PROPERTIES | method | limit/base | current | history 1 | history 2 | |
|------------------|--------|------------|---------|--------------|-----------|-----|
| Visc @ 40°C | cSt | ASTM D445 | 46 | 44.58 | 44.4 | --- |

| SAMPLE IMAGES | method | limit/base | current | history 1 | history 2 | |
|---------------|--------|------------|---------|-----------|-----------|--|
| Color | | | | | |  no image |
| Bottom | | | | | |  no image |

GRAPHS

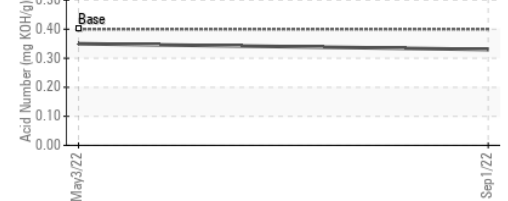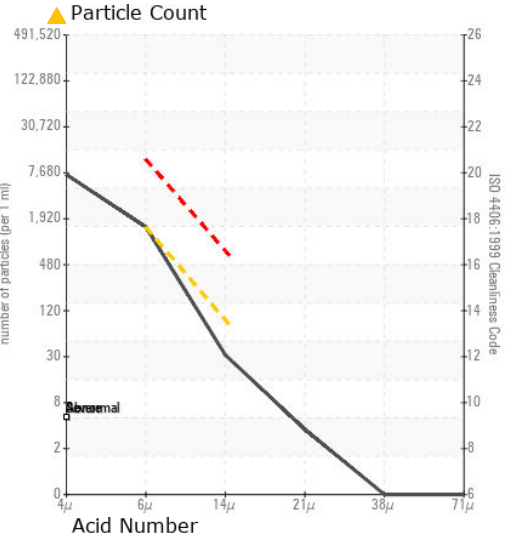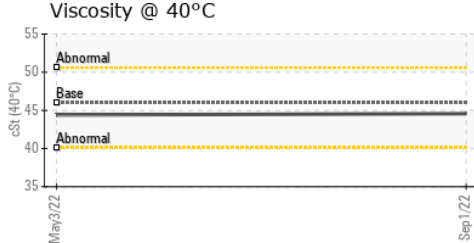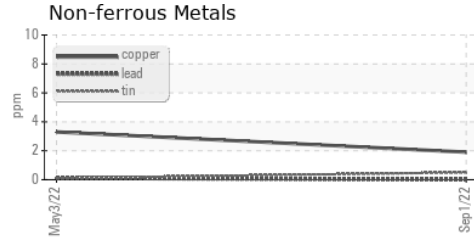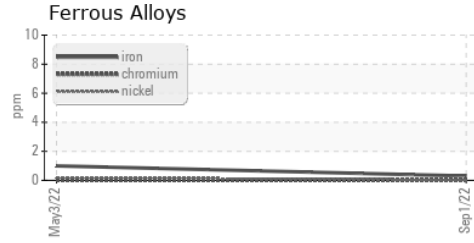

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : KC05637684 **Received** : 09 Sep 2022
Lab Number : 05637684 **Diagnosed** : 14 Sep 2022
Unique Number : 10127214 **Diagnostician** : Jonathan Hester
Test Package : IND 2

WALGREENS DISTRIBUTION CENTER
 350 RACO PKWY
 PENDERGRASS, GA
 USA 30567
 Contact:

To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)