


PROBLEM SUMMARY

Sample Rating Trend



ISO

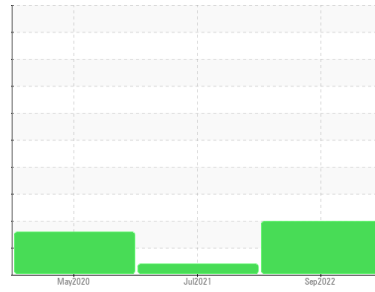


Machine Id
6324256 (S/N 1486)

Component
Compressor

Fluid
KAESER SIGMA (OEM) S-460 (--- GAL)

COMPONENT CONDITION SUMMARY

▲ Particle Trend

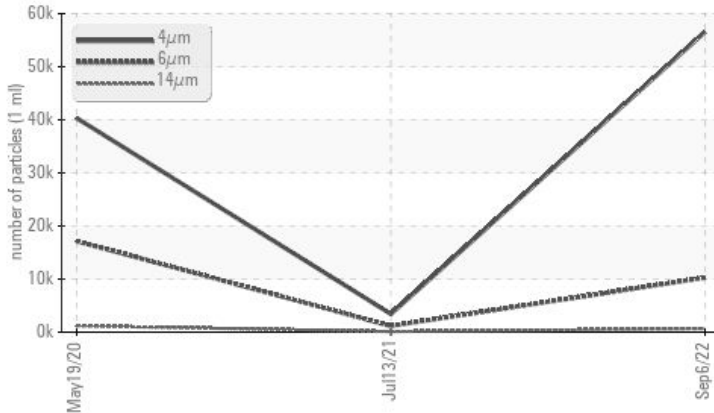

RECOMMENDATION

Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

PROBLEMATIC TEST RESULTS

Sample Status			ABNORMAL	ATTENTION	ABNORMAL
Particles >6µm	ASTM D7647	>1300	▲ 10254	1158	▲ 17135
Particles >14µm	ASTM D7647	>80	▲ 651	▲ 103	▲ 1199
Particles >21µm	ASTM D7647	>20	▲ 123	26	▲ 168
Particles >38µm	ASTM D7647	>4	▲ 7	3	▲ 9
Oil Cleanliness	ISO 4406 (c)	>--/17/13	▲ 23/21/17	▲ 17/14	▲ 21/17

Customer Id: EDWVIR
Sample No.: KC106579
Lab Number: 05639121
Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:
Jonathan Hester +1 919-379-4092 x4092
jhester@wearcheckusa.com

To change component or sample information:
Customer Service +1 1-800-237-1369
customerservice@wearcheck.com

RECOMMENDED ACTIONS

Action	Status	Date	Done By	Description
Change Fluid	---	---	?	Oil and filter change at the time of sampling has been noted.
Change Filter	---	---	?	Oil and filter change at the time of sampling has been noted.

HISTORICAL DIAGNOSIS

13 Jul 2021 Diag: Angela Borella

ISO



Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor. All component wear rates are normal. The amount and size of particulates present in the system are acceptable. There is no indication of any contamination in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

[view report](#)



19 May 2020 Diag: Angela Borella

ISO




No corrective action is recommended at this time. Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor. All component wear rates are normal. There is a high amount of particulates present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

[view report](#)



OIL ANALYSIS REPORT

Sample Rating Trend

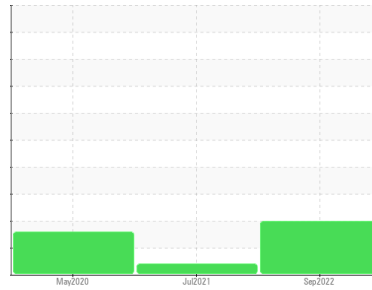

ISO



Machine Id
6324256 (S/N 1486)
Component
Compressor
Fluid
KAESER SIGMA (OEM) S-460 (--- GAL)

DIAGNOSIS

▲ Recommendation

Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

▲ Contamination

There is a high amount of particulates present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

	method	limit/base	current	history 1	history 2
Sample Number			KC106579	KC98600	KC74180
Sample Date			06 Sep 2022	13 Jul 2021	19 May 2020
Machine Age	hrs		11350	8025	5048
Oil Age	hrs		4080	3000	3000
Oil Changed			Changed	Changed	Changed
Sample Status			ABNORMAL	ATTENTION	ABNORMAL

WEAR METALS

	method	limit/base	current	history 1	history 2
Iron	ppm	ASTM D5185m >50	<1	0	1
Chromium	ppm	ASTM D5185m >10	0	0	0
Nickel	ppm	ASTM D5185m >3	0	<1	0
Titanium	ppm	ASTM D5185m >3	0	0	0
Silver	ppm	ASTM D5185m >2	<1	<1	0
Aluminum	ppm	ASTM D5185m >10	<1	0	0
Lead	ppm	ASTM D5185m >10	<1	0	0
Copper	ppm	ASTM D5185m >50	11	13	13
Tin	ppm	ASTM D5185m >10	<1	<1	0
Antimony	ppm	ASTM D5185m	---	0	0
Vanadium	ppm	ASTM D5185m	0	0	0
Cadmium	ppm	ASTM D5185m	0	0	0

ADDITIVES

	method	limit/base	current	history 1	history 2
Boron	ppm	ASTM D5185m	0	<1	<1
Barium	ppm	ASTM D5185m 90	<1	0	0
Molybdenum	ppm	ASTM D5185m	0	0	0
Manganese	ppm	ASTM D5185m	0	<1	<1
Magnesium	ppm	ASTM D5185m 90	20	19	26
Calcium	ppm	ASTM D5185m 2	<1	0	0
Phosphorus	ppm	ASTM D5185m	10	3	3
Zinc	ppm	ASTM D5185m	60	58	82

CONTAMINANTS

	method	limit/base	current	history 1	history 2
Silicon	ppm	ASTM D5185m >25	<1	0	1
Sodium	ppm	ASTM D5185m	6	10	17
Potassium	ppm	ASTM D5185m >20	5	8	7
Water	%	ASTM D6304 >0.05	0.013	0.013	0.020
ppm Water	ppm	ASTM D6304 >500	132.4	134.9	204.9


FLUID CLEANLINESS

	method	limit/base	current	history 1	history 2
Particles >4µm	ASTM D7647		56555	3419	40314
Particles >6µm	ASTM D7647	>1300	▲ 10254	1158	▲ 17135
Particles >14µm	ASTM D7647	>80	▲ 651	▲ 103	▲ 1199
Particles >21µm	ASTM D7647	>20	▲ 123	26	▲ 168
Particles >38µm	ASTM D7647	>4	▲ 7	3	▲ 9
Particles >71µm	ASTM D7647	>3	▲ 1	0	0
Oil Cleanliness	ISO 4406 (c)	>--/17/13	▲ 23/21/17	▲ 17/14	▲ 21/17

FLUID DEGRADATION

	method	limit/base	current	history 1	history 2
Acid Number (AN)	mg KOH/g	ASTM D8045 0.4	0.33	0.329	0.341


OIL ANALYSIS REPORT

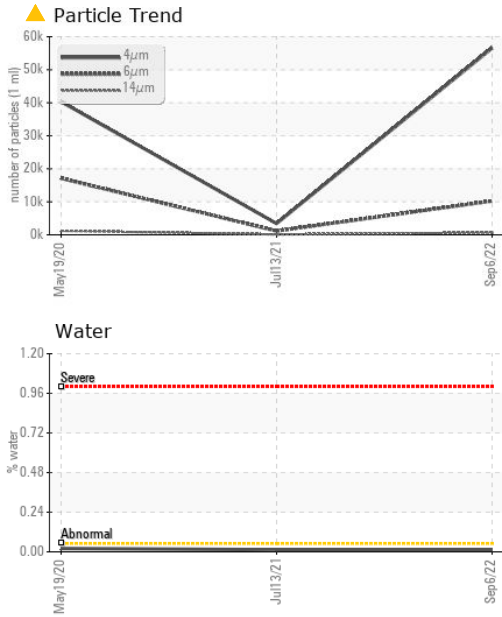



VISUAL	method	limit/base	current	history 1	history 2
White Metal	scalar	*Visual	NONE	NONE	MODER
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history 1	history 2
Visc @ 40°C	cSt	ASTM D445 46	43.9	45.3	45.3

SAMPLE IMAGES	method	limit/base	current	history 1	history 2
---------------	--------	------------	---------	-----------	-----------

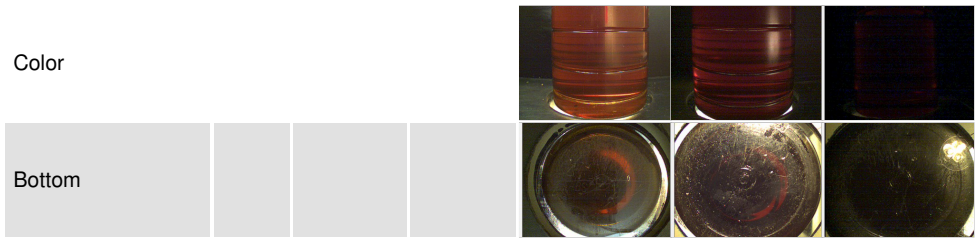

GRAPHS

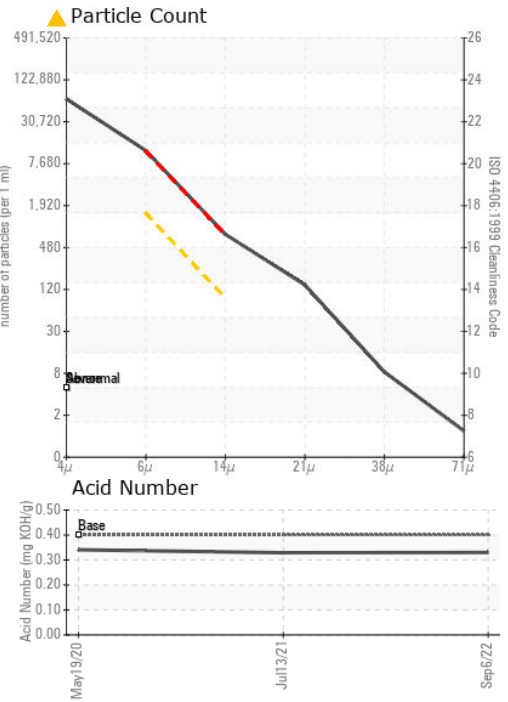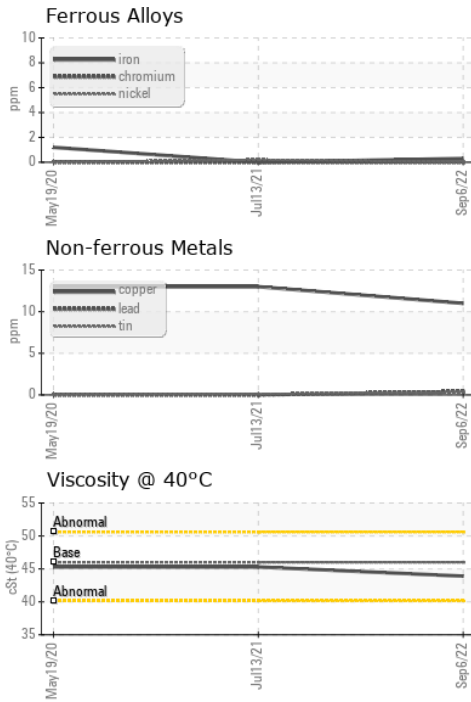

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : KC106579 **Received** : 12 Sep 2022
Lab Number : 05639121 **Diagnosed** : 14 Sep 2022
Unique Number : 10128651 **Diagnostician** : Jonathan Hester
Test Package : IND 2

EDWARDS-COUNCILOR CO
 1427 BAKER RD
 VIRGINIA BEACH, VA
 USA 23455
 Contact: Service Manager

To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)