

# **PROBLEM SUMMARY**

Sample Rating Trend

ISO

## Machine Id


# KAESER 7781170 (S/N 1038)

Component

Compressor

KAESER SIGMA (OEM) M-460 (--- QTS)

## **COMPONENT CONDITION SUMMARY**

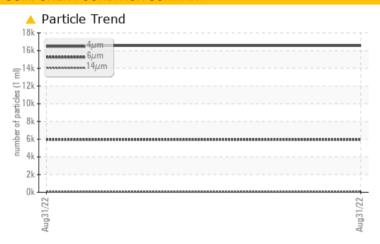

### RECOMMENDATION

No corrective action is recommended at this time. Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

PROBLEMATIC TEST RESULTS								
Sample Status			ABNORMAL					
Particles >6µm	ASTM D7647	>1300	<b>△</b> 5944					
Particles >14μm	ASTM D7647	>80	<b>A</b> 89					
Oil Cleanliness	ISO 4406 (c)	>/17/13	<b>1</b> 21/20/14					

Customer Id: LEAWES Sample No.: KCP49301 Lab Number: 05640359 Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data: Doug Bogart +1 (800)237-1369 x4016 dougb@wearcheckusa.com

To change component or sample information: Customer Service +1 1-800-237-1369 customerservice@wearcheck.com

RECOMMENDED ACTIONS					
Action	Status	Date	Done By	Description	
Change Fluid			?	Oil and filter change at the time of sampling has been noted.	
Change Filter			?	Oil and filter change at the time of sampling has been noted.	

# HISTORICAL DIAGNOSIS




# **OIL ANALYSIS REPORT**

# KAESER 7781170 (S/N 1038)

Compressor

KAESER SIGMA (OEM) M-460 (--- QTS)



## **DIAGNOSIS**

#### Recommendation

No corrective action is recommended at this time. Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

#### Wear

All component wear rates are normal.

## Contamination

There is a high amount of particulates present in the oil.


### **Fluid Condition**

The condition of the oil is suitable for further service.


				Aug2022		
SAMPLE INFORM	MATION	method	limit/base	current	history 1	history 2
Sample Number				KCP49301		
Sample Date				31 Aug 2022		
Machine Age	hrs			1717		
Oil Age	hrs			1717		
Oil Changed				Changed		
Sample Status				ABNORMAL		
WEAR METALS		method	limit/base	current	history 1	history 2
Iron	ppm	ASTM D5185m	>50	1		
Chromium	ppm	ASTM D5185m	>10	0		
Nickel	ppm	ASTM D5185m	>3	0		
Titanium	ppm	ASTM D5185m	>3	0		
Silver	ppm	ASTM D5185m	>2	<1		
Aluminum	ppm	ASTM D5185m	>10	<1		
Lead	ppm	ASTM D5185m	>10	<1		
Copper	ppm	ASTM D5185m	>50	2		
Tin	ppm	ASTM D5185m	>10	<1		
Vanadium	ppm	ASTM D5185m		0		
Cadmium	ppm	ASTM D5185m		0		
ADDITIVES		method	limit/base	current	history 1	history 2
Boron	ppm	ASTM D5185m	0	0		
Barium	ppm	ASTM D5185m	90	0		
Molybdenum	ppm	ASTM D5185m	0	0		
Manganese	ppm	ASTM D5185m		<1		
Magnesium	ppm	ASTM D5185m	100	59		
Calcium	ppm	ASTM D5185m	0	<1		
Phosphorus	ppm	ASTM D5185m	0	2		
Zinc	ppm	ASTM D5185m	0	43		
Sulfur	ppm	ASTM D5185m	23500	16969		
CONTAMINANTS	6	method	limit/base	current	history 1	history 2
Silicon	ppm	ASTM D5185m	>25	<1		
Sodium	ppm	ASTM D5185m	720	12		
Potassium	ppm	ASTM D5185m	>20	10		
Water	%	ASTM D6304	>0.05	0.035		
ppm Water	ppm		>500	352.7		
FLUID CLEANLIN	NESS	method	limit/base	current	history 1	history 2
Particles >4µm		ASTM D7647		16550		
Particles >6µm			>1300	<u> </u>		
Particles >14µm		ASTM D7647	>80	<u>▲</u> 89		
Particles >21µm		ASTM D7647		9		
Particles >38µm		ASTM D7647	>4	1		
Particles >71µm		ASTM D7647		0		
Oil Cleanliness		ISO 4406 (c)	>/17/13	△ 21/20/14		
FLUID DEGRADA	ATION	method	limit/base	current	history 1	history 2
Acid Number (AN)	mg KOH/g	ASTM D8045	1.0	0.41		
(/	5 9		-	- •		



# **OIL ANALYSIS REPORT**

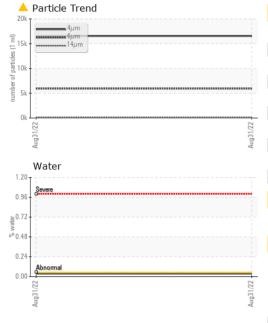



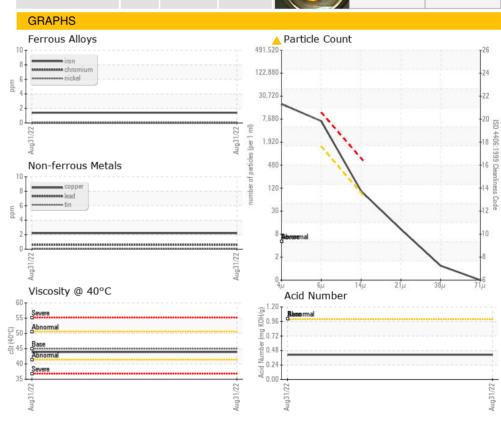





Certificate L2367

Laboratory Sample No.

Lab Number **Unique Number** 

: 10129889

: WearCheck USA - 501 Madison Ave., Cary, NC 27513 : KCP49301 Received : 05640359

: 13 Sep 2022 Diagnosed

: 15 Sep 2022 Diagnostician : Doug Bogart

Test Package : IND 2 ( Additional Tests: KF, PrtCount )

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

**Bottom** 

LEADING EDGE AUTOSPORT LLC

no image

no image

319 WESTTOWN RD 51 WEST CHESTER, PA USA 19382

Contact: Service Manager

T: F: