



Machine Id
KAESER SK-19 2192153 (S/N 1700)
Component
Compressor
Fluid
KAESER SIGMA (OEM) S-460 (--- GAL)

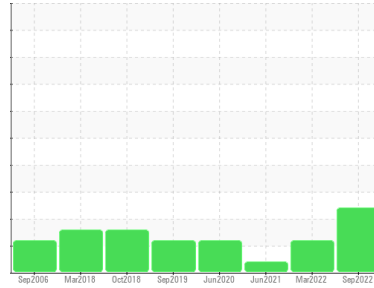

COMPONENT CONDITION SUMMARY

▲ Particle Trend

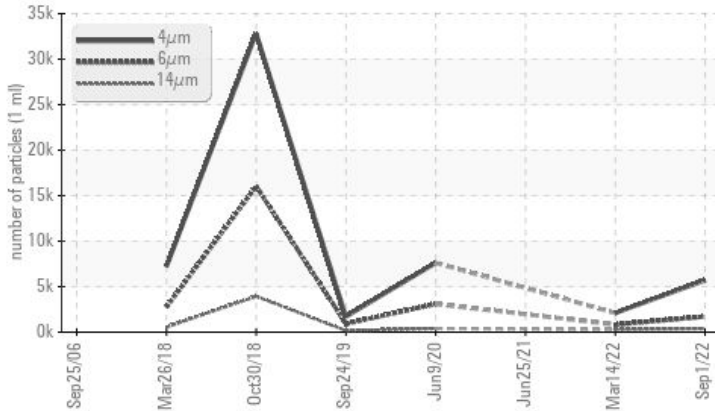

RECOMMENDATION

Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

PROBLEMATIC TEST RESULTS

Sample Status	ASTM D7647	ISO 4406 (c)	ABNORMAL	ABNORMAL	ABNORMAL
Particles >6µm	>1300	▲ 1717	▲ 1717	827	---
Particles >14µm	>80	▲ 368	▲ 368	▲ 273	---
Particles >21µm	>20	▲ 150	▲ 150	▲ 100	---
Particles >38µm	>4	▲ 12	▲ 12	▲ 17	---
Particles >71µm	>3	▲ 2	▲ 2	0	---
Oil Cleanliness	>--/17/13	▲ 20/18/16	▲ 20/18/16	▲ 17/15	---

Customer Id: ANCBAL
Sample No.: KCP37332
Lab Number: 05640375
Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:
Jonathan Hester +1 919-379-4092 x4092
jhester@wearcheckusa.com

To change component or sample information:
Customer Service +1 1-800-237-1369
customerservice@wearcheck.com

RECOMMENDED ACTIONS

Action	Status	Date	Done By	Description
Change Fluid	---	---	?	Oil and filter change at the time of sampling has been noted.
Change Filter	---	---	?	Oil and filter change at the time of sampling has been noted.

HISTORICAL DIAGNOSIS

14 Mar 2022 Diag: Jonathan Hester

ISO



The filter change at the time of sampling has been noted. Resample at the next service interval to monitor. All component wear rates are normal. There is a high amount of particulates present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

[view report](#)



25 Jun 2021 Diag: Jonathan Hester

VIS DEBRIS



Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor. We were unable to perform a particle count due to a high concentration of particles present in this sample. All component wear rates are normal. Moderate concentration of visible dirt/debris present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

[view report](#)



09 Jun 2020 Diag: Angela Borella

ISO




No corrective action is recommended at this time. Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor. All component wear rates are normal. There is a high amount of particulates present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

[view report](#)



Machine Id
KAESER SK-19 2192153 (S/N 1700)

Component
Compressor
Fluid
KAESER SIGMA (OEM) S-460 (--- GAL)

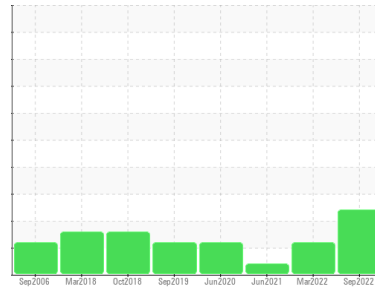

DIAGNOSIS

▲ Recommendation

Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

▲ Contamination

There is a high amount of particulates present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

	method	limit/base	current	history 1	history 2
Sample Number			KCP37332	KC96728	KCP33981
Sample Date			01 Sep 2022	14 Mar 2022	25 Jun 2021
Machine Age	hrs		38103	37906	37518
Oil Age	hrs		1500	388	1060
Oil Changed			Changed	Not Changd	Changed
Sample Status			ABNORMAL	ABNORMAL	ABNORMAL

WEAR METALS

	method	limit/base	current	history 1	history 2
Iron	ppm	ASTM D5185m >50	<1	<1	1
Chromium	ppm	ASTM D5185m >10	0	0	0
Nickel	ppm	ASTM D5185m >3	0	0	0
Titanium	ppm	ASTM D5185m >3	0	0	0
Silver	ppm	ASTM D5185m >2	<1	<1	0
Aluminum	ppm	ASTM D5185m >10	<1	<1	<1
Lead	ppm	ASTM D5185m >10	<1	0	0
Copper	ppm	ASTM D5185m >50	2	<1	2
Tin	ppm	ASTM D5185m >10	<1	0	0
Antimony	ppm	ASTM D5185m	---	---	0
Vanadium	ppm	ASTM D5185m	0	0	0
Cadmium	ppm	ASTM D5185m	<1	0	0

ADDITIVES

	method	limit/base	current	history 1	history 2
Boron	ppm	ASTM D5185m	0	<1	13
Barium	ppm	ASTM D5185m 90	0	0	0
Molybdenum	ppm	ASTM D5185m	0	0	0
Manganese	ppm	ASTM D5185m	<1	<1	<1
Magnesium	ppm	ASTM D5185m 90	52	76	58
Calcium	ppm	ASTM D5185m 2	1	1	0
Phosphorus	ppm	ASTM D5185m	1	11	3
Zinc	ppm	ASTM D5185m	15	15	35
Sulfur	ppm	ASTM D5185m	15993	16793	18675

CONTAMINANTS

	method	limit/base	current	history 1	history 2
Silicon	ppm	ASTM D5185m >25	<1	<1	<1
Sodium	ppm	ASTM D5185m	15	23	25
Potassium	ppm	ASTM D5185m >20	4	4	4
Water	%	ASTM D6304 >0.05	0.026	0.013	0.027
ppm Water	ppm	ASTM D6304 >500	267.2	139.5	270.4


FLUID CLEANLINESS

	method	limit/base	current	history 1	history 2
Particles >4µm	ASTM D7647		5699	2102	---
Particles >6µm	ASTM D7647	>1300	▲ 1717	827	---
Particles >14µm	ASTM D7647	>80	▲ 368	▲ 273	---
Particles >21µm	ASTM D7647	>20	▲ 150	▲ 100	---
Particles >38µm	ASTM D7647	>4	▲ 12	▲ 17	---
Particles >71µm	ASTM D7647	>3	▲ 2	0	---
Oil Cleanliness	ISO 4406 (c)	>--/17/13	▲ 20/18/16	▲ 17/15	---

FLUID DEGRADATION

	method	limit/base	current	history 1	history 2
Acid Number (AN)	mg KOH/g	ASTM D8045 0.4	0.37	0.32	0.348


OIL ANALYSIS REPORT

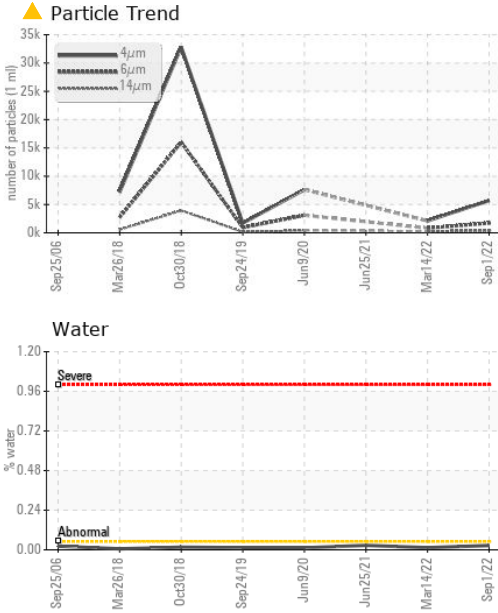



PARAMETER	method	limit/base	current	history 1	history 2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	▲ MODER
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history 1	history 2
Visc @ 40°C	cSt	ASTM D445 46	43.9	43.8	45.5

SAMPLE IMAGES	method	limit/base	current	history 1	history 2
---------------	--------	------------	---------	-----------	-----------

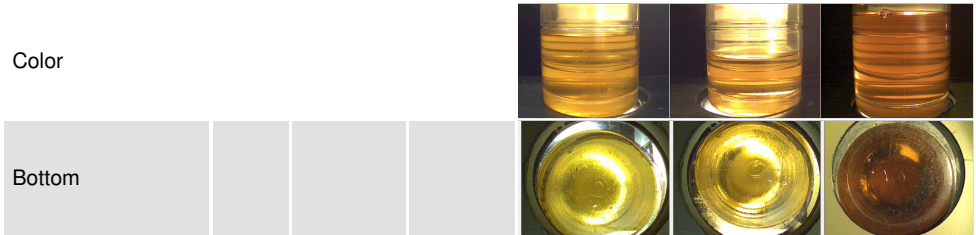

GRAPHS

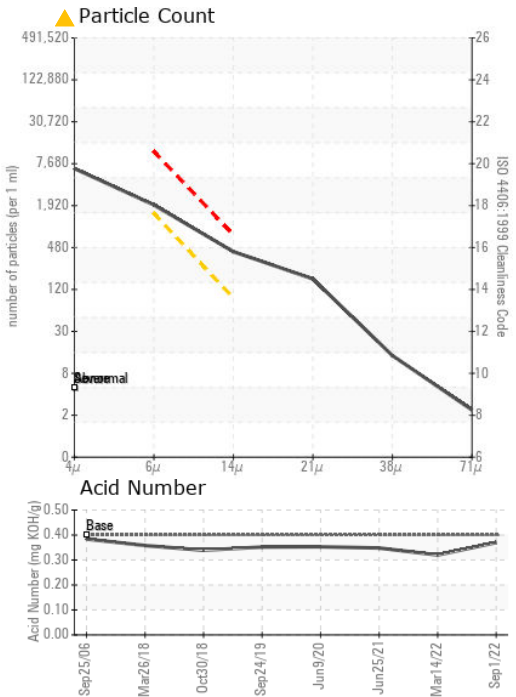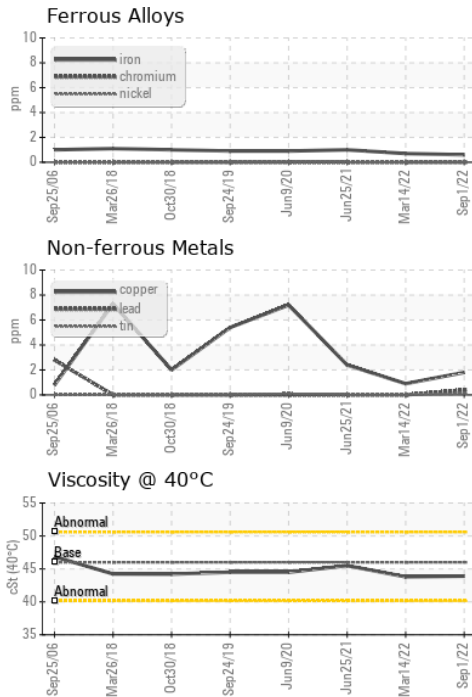

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : KCP37332 **Received** : 13 Sep 2022
Lab Number : 05640375 **Diagnosed** : 15 Sep 2022
Unique Number : 10129905 **Diagnostician** : Jonathan Hester
Test Package : IND 2 (Additional Tests: KF, PrtCount)

ANCHOR BAY MARINA
 8500 COVE RD.
 BALTIMORE, MD
 USA 21222
 Contact: SERVICE MANAGER

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:
F: