


# PROBLEM SUMMARY

Sample Rating Trend



## VISCOSITY

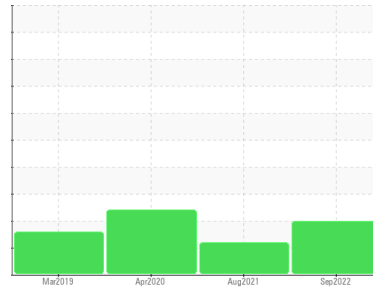


Machine Id  
**KAESER AS 30T 5909420 (S/N 1335)**

Component  
**Compressor**


Fluid  
**KAESER SIGMA (OEM) M-460 (--- GAL)**

### COMPONENT CONDITION SUMMARY

▲ Viscosity @ 40°C

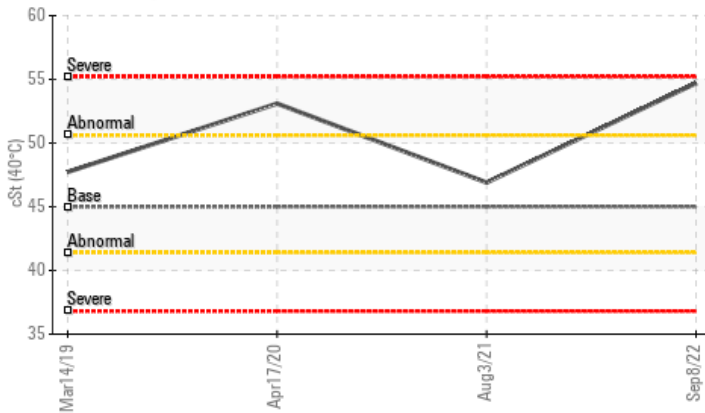

▲ Particle Trend

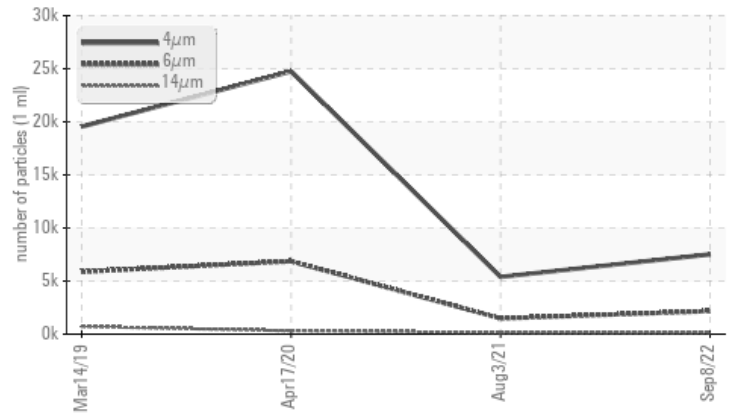

### RECOMMENDATION

Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

### PROBLEMATIC TEST RESULTS

Sample Status			ABNORMAL	ATTENTION	ABNORMAL	
Particles >6µm	ASTM D7647	>1300	▲ 2170	▲ 1474	▲ 6867	
Particles >14µm	ASTM D7647	>80	▲ 143	▲ 151	▲ 309	
Particles >21µm	ASTM D7647	>20	▲ 28	▲ 44	▲ 56	
Oil Cleanliness	ISO 4406 (c)	>--/17/13	▲ 20/18/14	▲ 18/14	▲ 20/15	
Visc @ 40°C	cSt	ASTM D445	45	▲ 54.7	46.9	▲ 53.1

Customer Id: INDGAS  
Sample No.: KCP46183  
Lab Number: 05644262  
Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:  
Don Baldrige +1  
[don.b505@comcast.net](mailto:don.b505@comcast.net)

To change component or sample information:  
Customer Service +1 1-800-237-1369  
[customerservice@wearcheck.com](mailto:customerservice@wearcheck.com)

## RECOMMENDED ACTIONS

Action	Status	Date	Done By	Description
Change Fluid	---	---	?	Oil and filter change at the time of sampling has been noted.
Change Filter	---	---	?	Oil and filter change at the time of sampling has been noted.

## HISTORICAL DIAGNOSIS

### 03 Aug 2021 Diag: Don Baldrige

ISO



Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor. All component wear rates are normal. There is a moderate amount of particulates present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report



### 17 Apr 2020 Diag: Jonathan Hester

VISCOSITY



Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor. All component wear rates are normal. There is a high amount of particulates present in the oil. The oil viscosity is higher than normal. The AN level is acceptable for this fluid.

view report



### 14 Mar 2019 Diag: Doug Bogart

ISO




Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor. All component wear rates are normal. There is a high amount of particulates present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report



Machine Id  
**KAESER AS 30T 5909420 (S/N 1335)**  
Component  
**Compressor**  
Fluid  
**KAESER SIGMA (OEM) M-460 (--- GAL)**

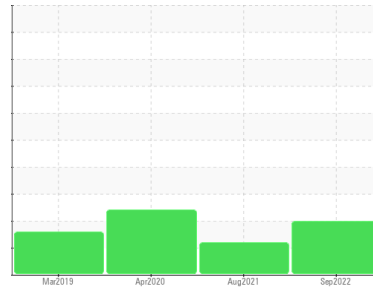

**DIAGNOSIS**

**▲ Recommendation**

Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

**Wear**

All component wear rates are normal.

**▲ Contamination**

There is a moderate amount of particulates present in the oil.

**▲ Fluid Condition**

The oil viscosity is higher than normal. The AN level is acceptable for this fluid.

**SAMPLE INFORMATION**

	method	limit/base	current	history 1	history 2
Sample Number			<b>KCP46183</b>	KCP41722	KCP24850
Sample Date			<b>08 Sep 2022</b>	03 Aug 2021	17 Apr 2020
Machine Age	hrs		<b>26739</b>	21966	14900
Oil Age	hrs		<b>3000</b>	3000	3000
Oil Changed			<b>Changed</b>	Changed	Changed
Sample Status			<b>ABNORMAL</b>	ATTENTION	ABNORMAL

**WEAR METALS**

	method	limit/base	current	history 1	history 2
Iron	ppm	ASTM D5185m >50	<b>0</b>	<1	0
Chromium	ppm	ASTM D5185m >10	<b>0</b>	0	0
Nickel	ppm	ASTM D5185m >3	<b>0</b>	0	<1
Titanium	ppm	ASTM D5185m >3	<b>0</b>	0	0
Silver	ppm	ASTM D5185m >2	<b>0</b>	<1	0
Aluminum	ppm	ASTM D5185m >10	<b>0</b>	1	<1
Lead	ppm	ASTM D5185m >10	<b>0</b>	0	0
Copper	ppm	ASTM D5185m >50	<b>24</b>	11	41
Tin	ppm	ASTM D5185m >10	<b>0</b>	0	0
Antimony	ppm	ASTM D5185m	<b>---</b>	0	0
Vanadium	ppm	ASTM D5185m	<b>0</b>	0	0
Cadmium	ppm	ASTM D5185m	<b>0</b>	0	0

**ADDITIVES**

	method	limit/base	current	history 1	history 2
Boron	ppm	ASTM D5185m 0	<b>0</b>	<1	0
Barium	ppm	ASTM D5185m 90	<b>&lt;1</b>	0	0
Molybdenum	ppm	ASTM D5185m 0	<b>0</b>	0	<1
Manganese	ppm	ASTM D5185m	<b>0</b>	<1	0
Magnesium	ppm	ASTM D5185m 100	<b>0</b>	20	<1
Calcium	ppm	ASTM D5185m 0	<b>0</b>	0	0
Phosphorus	ppm	ASTM D5185m 0	<b>2</b>	9	2
Zinc	ppm	ASTM D5185m 0	<b>0</b>	56	7
Sulfur	ppm	ASTM D5185m 23500	<b>10857</b>	18766	16474

**CONTAMINANTS**

	method	limit/base	current	history 1	history 2
Silicon	ppm	ASTM D5185m >25	<b>&lt;1</b>	<1	2
Sodium	ppm	ASTM D5185m	<b>0</b>	6	<1
Potassium	ppm	ASTM D5185m >20	<b>0</b>	2	0
Water	%	ASTM D6304 >0.05	<b>0.004</b>	0.014	0.007
ppm Water	ppm	ASTM D6304 >500	<b>41.8</b>	149.0	70.5


**FLUID CLEANLINESS**

	method	limit/base	current	history 1	history 2
Particles >4µm	ASTM D7647		<b>7519</b>	5391	24754
Particles >6µm	ASTM D7647	>1300	<b>▲ 2170</b>	▲ 1474	▲ 6867
Particles >14µm	ASTM D7647	>80	<b>▲ 143</b>	▲ 151	▲ 309
Particles >21µm	ASTM D7647	>20	<b>▲ 28</b>	▲ 44	▲ 56
Particles >38µm	ASTM D7647	>4	<b>0</b>	3	▲ 5
Particles >71µm	ASTM D7647	>3	<b>0</b>	0	▲ 2
Oil Cleanliness	ISO 4406 (c)	>--/17/13	<b>▲ 20/18/14</b>	▲ 18/14	▲ 20/15

**FLUID DEGRADATION**

	method	limit/base	current	history 1	history 2
Acid Number (AN)	mg KOH/g	ASTM D8045 1.0	<b>0.43</b>	0.363	0.399


# OIL ANALYSIS REPORT

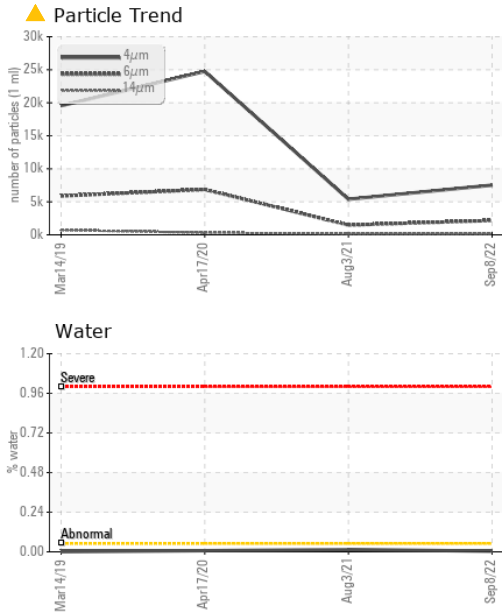






PARAMETER	method	limit/base	current	history 1	history 2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

PARAMETER	method	limit/base	current	history 1	history 2
Visc @ 40°C	cSt	ASTM D445	45	54.7	46.9

PARAMETER	method	limit/base	current	history 1	history 2
-----------	--------	------------	---------	-----------	-----------

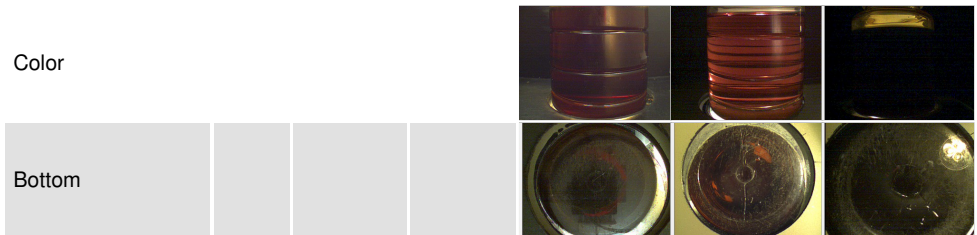

## GRAPHS

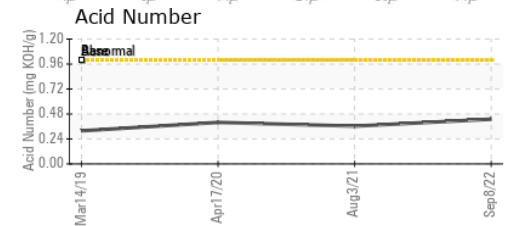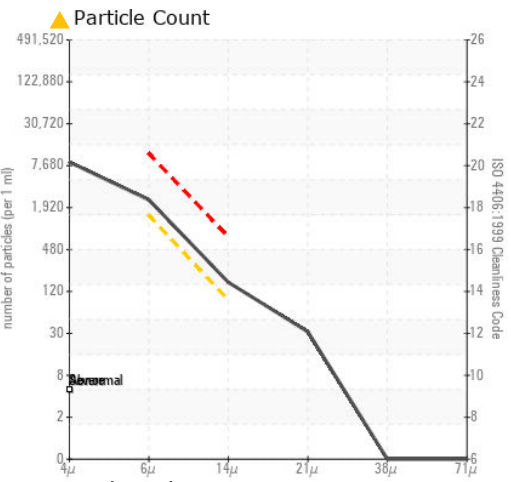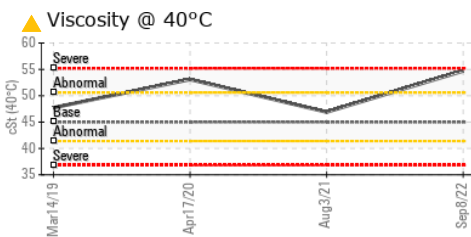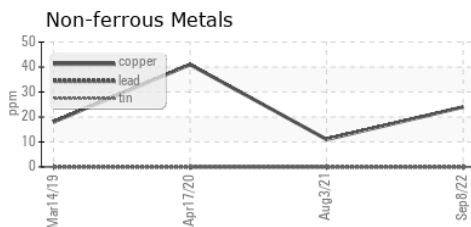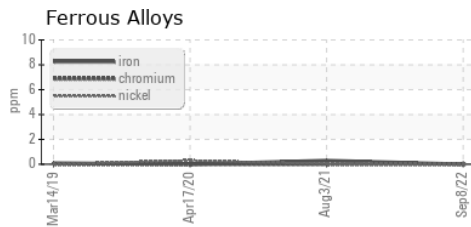

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : KCP46183 **Received** : 16 Sep 2022  
**Lab Number** : 05644262 **Diagnosed** : 20 Sep 2022  
**Unique Number** : 10138801 **Diagnostician** : Don Baldrige  
**Test Package** : IND 2 ( Additional Tests: KF, PrtCount )

**INDUSTRIAL GLASS TECHNOLOGIES**  
 112 SUPERIOR STAINLESS RD  
 GASTONIA, NC  
 USA 28052  
 Contact: Service Manager

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)