

PROBLEM SUMMARY

Sample Rating Trend




ISO



Machine Id
KAESER 7057748
Component
Compressor
Fluid
NOT GIVEN (--- GAL)

COMPONENT CONDITION SUMMARY

▲ Particle Trend

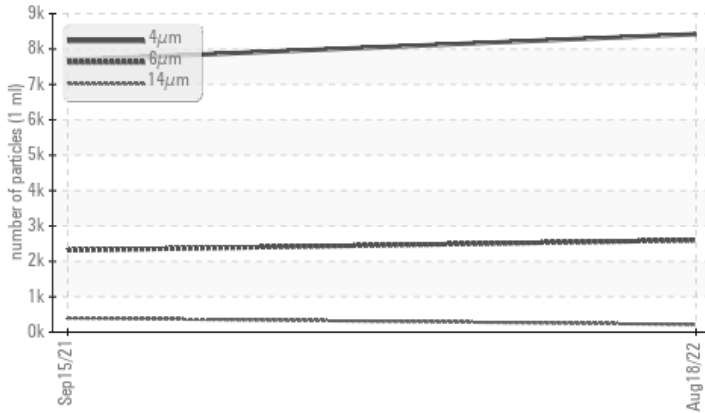

RECOMMENDATION

Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

PROBLEMATIC TEST RESULTS

Sample Status			ABNORMAL	ABNORMAL	---
Particles >6µm	ASTM D7647	>1300	▲ 2598	▲ 2313	---
Particles >14µm	ASTM D7647	>80	▲ 213	▲ 399	---
Particles >21µm	ASTM D7647	>20	▲ 61	▲ 119	---
Oil Cleanliness	ISO 4406 (c)	>--/17/13	▲ 20/19/15	▲ 18/16	---

Customer Id: HORCONKC
Sample No.: KC107357
Lab Number: 05644878
Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:
Angela Borella +1 800-237-1369
angela.borella@wearcheckusa.com

To change component or sample information:
Customer Service +1 1-800-237-1369
customerservice@wearcheck.com

RECOMMENDED ACTIONS

Action	Status	Date	Done By	Description
Change Fluid	---	---	?	Oil and filter change at the time of sampling has been noted.
Change Filter	---	---	?	Oil and filter change at the time of sampling has been noted.

HISTORICAL DIAGNOSIS

15 Sep 2021 Diag: Jonathan Hester

ISO



Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor. All component wear rates are normal. There is a high amount of particulates present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report



Machine Id
KAESER 7057748
Component
Compressor
Fluid
NOT GIVEN (--- GAL)



DIAGNOSIS

▲ Recommendation

Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

▲ Contamination

There is a high amount of particulates present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

	method	limit/base	current	history 1	history 2
Sample Number			KC107357	KC93124	---
Sample Date			18 Aug 2022	15 Sep 2021	---
Machine Age	hrs		20595	12826	---
Oil Age	hrs		4000	3269	---
Oil Changed			Changed	Changed	---
Sample Status			ABNORMAL	ABNORMAL	---

WEAR METALS

	method	limit/base	current	history 1	history 2
Iron	ppm ASTM D5185m	>50	0	0	---
Chromium	ppm ASTM D5185m	>10	0	0	---
Nickel	ppm ASTM D5185m	>3	0	0	---
Titanium	ppm ASTM D5185m	>3	0	0	---
Silver	ppm ASTM D5185m	>2	<1	0	---
Aluminum	ppm ASTM D5185m	>10	<1	3	---
Lead	ppm ASTM D5185m	>10	0	0	---
Copper	ppm ASTM D5185m	>50	9	9	---
Tin	ppm ASTM D5185m	>10	0	0	---
Antimony	ppm ASTM D5185m		---	0	---
Vanadium	ppm ASTM D5185m		0	0	---
Cadmium	ppm ASTM D5185m		0	0	---

ADDITIVES

	method	limit/base	current	history 1	history 2
Boron	ppm ASTM D5185m		0	<1	---
Barium	ppm ASTM D5185m		0	0	---
Molybdenum	ppm ASTM D5185m		0	0	---
Manganese	ppm ASTM D5185m		0	0	---
Magnesium	ppm ASTM D5185m		0	4	---
Calcium	ppm ASTM D5185m		0	0	---
Phosphorus	ppm ASTM D5185m		2	2	---
Zinc	ppm ASTM D5185m		0	<1	---

CONTAMINANTS

	method	limit/base	current	history 1	history 2
Silicon	ppm ASTM D5185m	>25	<1	0	---
Sodium	ppm ASTM D5185m		0	0	---
Potassium	ppm ASTM D5185m	>20	0	0	---
Water	% ASTM D6304	>0.05	0.012	0.010	---
ppm Water	ppm ASTM D6304	>500	123.8	101.7	---


FLUID CLEANLINESS

	method	limit/base	current	history 1	history 2
Particles >4µm	ASTM D7647		8420	7691	---
Particles >6µm	ASTM D7647	>1300	▲ 2598	▲ 2313	---
Particles >14µm	ASTM D7647	>80	▲ 213	▲ 399	---
Particles >21µm	ASTM D7647	>20	▲ 61	▲ 119	---
Particles >38µm	ASTM D7647	>4	2	▲ 10	---
Particles >71µm	ASTM D7647	>3	0	0	---
Oil Cleanliness	ISO 4406 (c)	>--/17/13	▲ 20/19/15	▲ 18/16	---

FLUID DEGRADATION

	method	limit/base	current	history 1	history 2
Acid Number (AN)	mg KOH/g ASTM D8045		0.35	0.314	---


OIL ANALYSIS REPORT

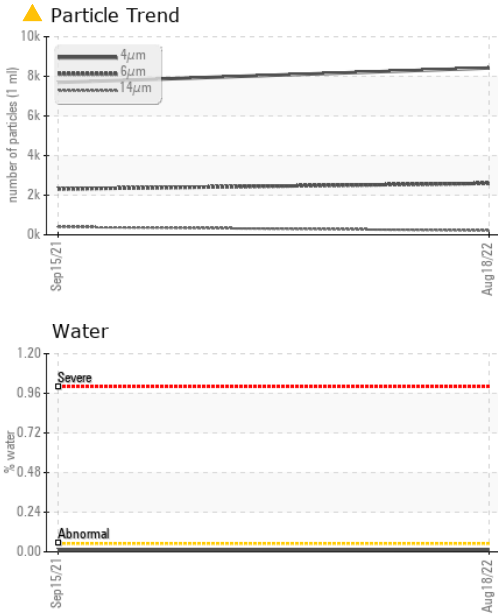



VISUAL	method	limit/base	current	history 1	history 2
White Metal	scalar	*Visual	NONE	NONE	VLITE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	LIGHT	VLITE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history 1	history 2
Visc @ 40°C	cSt	ASTM D445	44.3	44.0	---

SAMPLE IMAGES	method	limit/base	current	history 1	history 2
---------------	--------	------------	---------	-----------	-----------

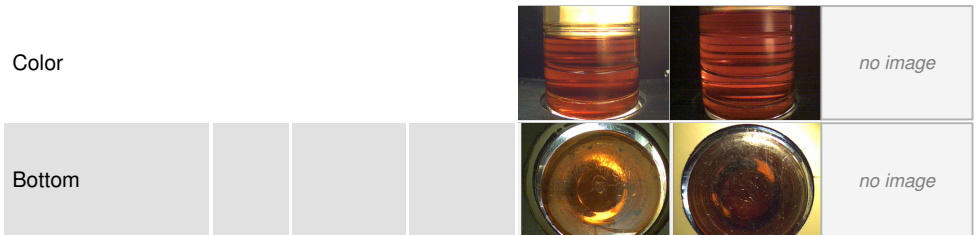

GRAPHS

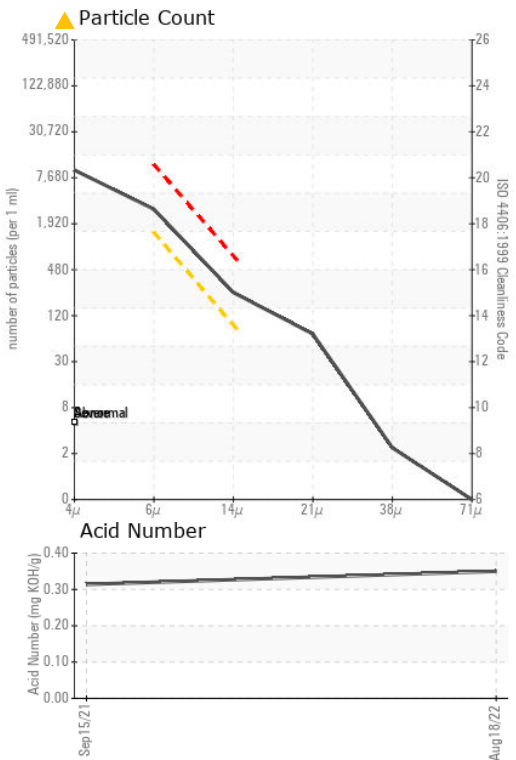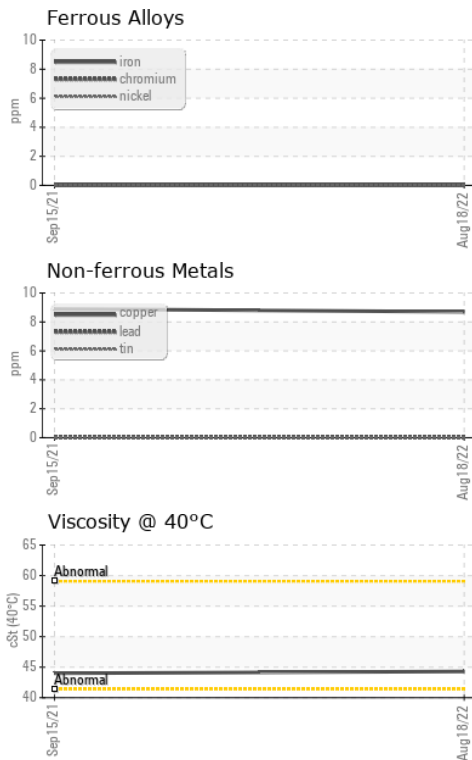

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : KC107357 **Received** : 19 Sep 2022
Lab Number : 05644878 **Diagnosed** : 20 Sep 2022
Unique Number : 10139417 **Diagnostician** : Angela Borella
Test Package : IND 2

HORRY COUNTY WASTE
 CONWAY, SC
 USA
 Contact: Service Manager

To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)