

PROBLEM SUMMARY


Sample Rating Trend

ISO


KAESER 3837264 (S/N 1200)

Compressor

KAESER SIGMA (OEM) M-460 (--- GAL)



COMPONENT CONDITION SUMMARY

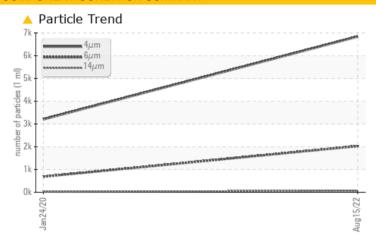

RECOMMENDATION

Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

PROBLEMATIC TEST	T RESULTS			
Sample Status		ATTENTION	NORMAL	
Particles >6μm	ASTM D7647 >130	0 4 2029	686	
Oil Cleanliness	ISO 4406 (c) >17/1	3 4 18/13	17/12	

Customer Id: BRAGRAKCP Sample No.: KCP44119 Lab Number: 05644908 Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data: Angela Borella +1 800-237-1369 angela.borella@wearcheckusa.com

To change component or sample information: Customer Service +1 1-800-237-1369 customerservice@wearcheck.com

Action Status Date Done By Description Change Fluid --- ? Oil and filter change at the time of sampling has been noted. Change Filter --- ? Oil and filter change at the time of sampling has been noted.

HISTORICAL DIAGNOSIS

24 Jan 2020 Diag: Don Baldridge

NORMAL



Resample at the next service interval to monitor. All component wear rates are normal. The amount and size of particulates present in the system are acceptable. There is no indication of any contamination in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.





OIL ANALYSIS REPORT

Sample Rating Trend

ISO

KAESER 3837264 (S/N 1200)

Compressor

KAESER SIGMA (OEM) M-460 (--- GAL)

DIAGNOSIS

Recommendation

Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

All component wear rates are normal.

Contamination

There is a moderate amount of silt (particulates < 14 microns in size) present in the oil.


Fluid Condition


The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

			Jan 2020	Aug2022		
SAMPLE INFORM	MATION	method	limit/base	current	history 1	history 2
Sample Number				KCP44119	KCP25907	
Sample Date				15 Aug 2022	24 Jan 2020	
Machine Age	hrs			4443	3323	
Oil Age	hrs			1000	1000	
Oil Changed				Changed	Changed	
Sample Status				ATTENTION	NORMAL	
WEAR METALS		method	limit/base	current	history 1	history 2
Iron	ppm	ASTM D5185m	>50	0	<1	
Chromium	ppm	ASTM D5185m	>10	0	0	
Nickel	ppm	ASTM D5185m	>3	0	0	
Titanium	ppm	ASTM D5185m	>3	0	0	
Silver	ppm	ASTM D5185m	>2	<1	0	
Aluminum	ppm	ASTM D5185m	>10	<1	0	
Lead	ppm	ASTM D5185m	>10	0	<1	
Copper	ppm	ASTM D5185m	>50	7	14	
Tin	ppm	ASTM D5185m	>10	0	<1	
Antimony	ppm	ASTM D5185m			0	
Vanadium	ppm	ASTM D5185m		0	0	
Cadmium	ppm	ASTM D5185m		0	0	
ADDITIVES		method	limit/base	current	history 1	history 2
Boron	ppm	ASTM D5185m	0	0	0	
Barium	ppm	ASTM D5185m	90	0	<1	
Molybdenum	ppm	ASTM D5185m	0	0	0	
Manganese	ppm	ASTM D5185m		0	<1	
Magnesium	ppm	ASTM D5185m	100	2	14	
Calcium	ppm	ASTM D5185m	0	0	0	
Phosphorus	ppm	ASTM D5185m	0	3	<1	
Zinc	ppm	ASTM D5185m	0	3	20	
Sulfur	ppm	ASTM D5185m	23500	16980	16016	
CONTAMINANTS		method	limit/base	current	history 1	history 2
Silicon	ppm	ASTM D5185m	>25	<1	0	
Sodium	ppm	ASTM D5185m		<1	4	
Potassium	ppm	ASTM D5185m	>20	0	<1	
Water	%	ASTM D6304	>0.05	0.005	0.004	
ppm Water	ppm	ASTM D6304	>500	58.5	46.8	
FLUID CLEANLIN	IESS	method	limit/base	current	history 1	history 2
Particles >4µm		ASTM D7647		6840	3204	
Particles >6µm		ASTM D7647	>1300	^ 2029	686	
Particles >14µm		ASTM D7647	>80	67	26	
Particles >21µm		ASTM D7647	>20	8	10	
Particles >38µm		ASTM D7647	>4	0	1	
Particles >71μm		ASTM D7647	>3	0	0	
Oil Cleanliness		ISO 4406 (c)	>17/13	<u></u> 18/13	17/12	
FLUID DEGRADA	TION	method	limit/base	current	history 1	history 2
	ma K∩⊔/a	VSTM D804E	1.0	0.38	0.331	



OIL ANALYSIS REPORT

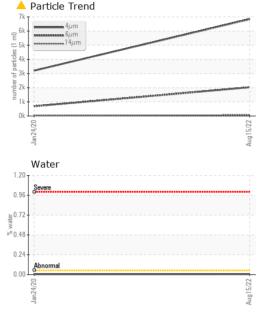

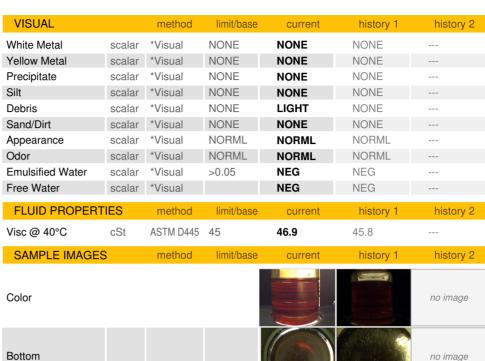

Ferrous Alloys	▲ Particle Count	
7	491,520	
- Iron -	122,880 -	
	30,720	
	7,680	
Jan 2 4/20	Aug 15/22. Aug 15/22. 100	
Non-ferrous Metals	A 480	
copper	120 -	
economica tin	30-	
1	8 Shreemal	
Jan 24/20	2 - 2 - 2 - 2 - 2 - 2 - 2 - 2 - 2 - 2 -	
	9 4u 6u 14u 2	21μ 38μ 71
Viscosity @ 40°C	Acid Number	.τμ 30μ 71
Severe	1.20 (1.00 Mappen mal mappen mal mappen mal mappen mal mappen mal mappen mal mappen ma	
Abnormal Base Abnormal	<u> </u>	
Abnormal	- E 0.48	
Severe	S 0.24	
Jan 2 4/20	Aug 15/22 Jan 24/20	



Laboratory Sample No. Lab Number Unique Number

: KCP44119 : 05644908 : 10139447

Received Diagnosed

: 19 Sep 2022 : 20 Sep 2022

Diagnostician : Angela Borella

GRAND JUNCTION, CO USA 81505

Contact: Service Manager

Test Package : IND 2 (Additional Tests: KF, PrtCount) Certificate L2367 To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T: F:

519 LIGRANI LN