


PROBLEM SUMMARY

Sample Rating Trend



ISO

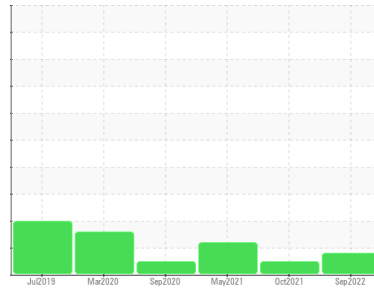


Machine Id
KAESER CSD 100 2929551 (S/N 1015)

Component
Compressor

Fluid
KAESER SIGMA (OEM) S-460 (--- GAL)

COMPONENT CONDITION SUMMARY

▲ Particle Trend

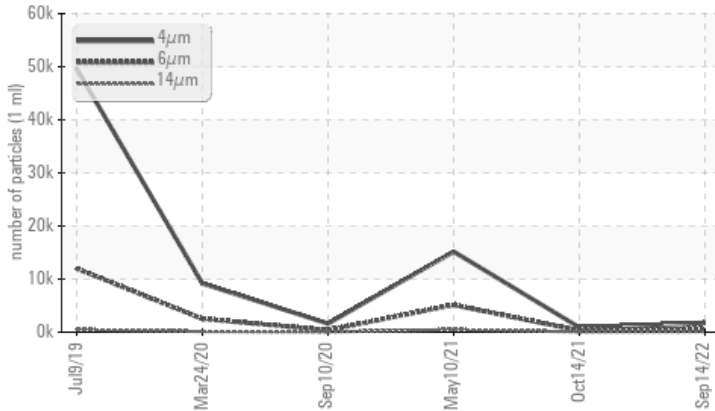

RECOMMENDATION

No corrective action is recommended at this time. Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

PROBLEMATIC TEST RESULTS

Sample Status		ATTENTION	NORMAL	ABNORMAL
Particles >14µm	ASTM D7647 >80	▲ 92	30	▲ 479
Oil Cleanliness	ISO 4406 (c) >--/17/13	▲ 18/16/14	15/12	▲ 20/16

Customer Id: SOFCHA
Sample No.: KCP49323
Lab Number: 05646600
Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:
Jonathan Hester +1 919-379-4092 x4092
jhester@wearcheckusa.com

To change component or sample information:
Customer Service +1 1-800-237-1369
customerservice@wearcheck.com

RECOMMENDED ACTIONS

Action	Status	Date	Done By	Description
Change Fluid	---	---	?	Oil and filter change at the time of sampling has been noted.
Change Filter	---	---	?	Oil and filter change at the time of sampling has been noted.

HISTORICAL DIAGNOSIS

14 Oct 2021 Diag: Jonathan Hester

NORMAL



Resample at the next service interval to monitor. All component wear rates are normal. The amount and size of particulates present in the system are acceptable. There is no indication of any contamination in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report



10 May 2021 Diag: Don Baldrige

ISO



No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor. All component wear rates are normal. There is a high amount of particulates present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report



10 Sep 2020 Diag: Doug Bogart

NORMAL



Resample at the next service interval to monitor. All component wear rates are normal. The amount and size of particulates present in the system are acceptable. There is no indication of any contamination in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report




Machine Id
KAESER CSD 100 2929551 (S/N 1015)

Component

Compressor

Fluid

KAESER SIGMA (OEM) S-460 (--- GAL)

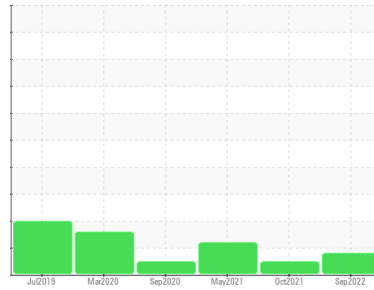

DIAGNOSIS

▲ Recommendation

No corrective action is recommended at this time. Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

▲ Contamination

There is a moderate amount of particulates present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

	method	limit/base	current	history 1	history 2
Sample Number			KCP49323	KCP38751	KCP33087
Sample Date			14 Sep 2022	14 Oct 2021	10 May 2021
Machine Age	hrs		41315	36338	32631
Oil Age	hrs		4667	7792	4085
Oil Changed			Changed	Changed	Not Changed
Sample Status			ATTENTION	NORMAL	ABNORMAL

WEAR METALS

	method	limit/base	current	history 1	history 2
Iron	ppm ASTM D5185m	>50	0	0	0
Chromium	ppm ASTM D5185m	>10	0	0	0
Nickel	ppm ASTM D5185m	>3	0	0	0
Titanium	ppm ASTM D5185m	>3	0	0	0
Silver	ppm ASTM D5185m	>2	0	0	0
Aluminum	ppm ASTM D5185m	>10	0	0	0
Lead	ppm ASTM D5185m	>10	0	0	0
Copper	ppm ASTM D5185m	>50	8	7	6
Tin	ppm ASTM D5185m	>10	0	0	0
Antimony	ppm ASTM D5185m		---	0	0
Vanadium	ppm ASTM D5185m		0	0	0
Cadmium	ppm ASTM D5185m		0	0	0

ADDITIVES

	method	limit/base	current	history 1	history 2
Boron	ppm ASTM D5185m		0	0	<1
Barium	ppm ASTM D5185m	90	0	0	0
Molybdenum	ppm ASTM D5185m		0	0	0
Manganese	ppm ASTM D5185m		0	0	0
Magnesium	ppm ASTM D5185m	90	0	0	<1
Calcium	ppm ASTM D5185m	2	0	0	0
Phosphorus	ppm ASTM D5185m		2	2	<1
Zinc	ppm ASTM D5185m		0	0	0
Sulfur	ppm ASTM D5185m		14820	12685	14074

CONTAMINANTS

	method	limit/base	current	history 1	history 2
Silicon	ppm ASTM D5185m	>25	0	0	0
Sodium	ppm ASTM D5185m		0	<1	0
Potassium	ppm ASTM D5185m	>20	0	0	<1
Water	% ASTM D6304	>0.05	0.009	0.008	0.005
ppm Water	ppm ASTM D6304	>500	98.9	86.4	53.9



FLUID CLEANLINESS

	method	limit/base	current	history 1	history 2
Particles >4µm	ASTM D7647		1778	889	15168
Particles >6µm	ASTM D7647	>1300	627	296	▲ 5126
Particles >14µm	ASTM D7647	>80	▲ 92	30	▲ 479
Particles >21µm	ASTM D7647	>20	16	7	▲ 134
Particles >38µm	ASTM D7647	>4	1	0	4
Particles >71µm	ASTM D7647	>3	0	0	0
Oil Cleanliness	ISO 4406 (c)	>--/17/13	▲ 18/16/14	15/12	▲ 20/16

FLUID DEGRADATION

	method	limit/base	current	history 1	history 2
Acid Number (AN)	mg KOH/g ASTM D8045	0.4	0.37	0.362	0.339


OIL ANALYSIS REPORT

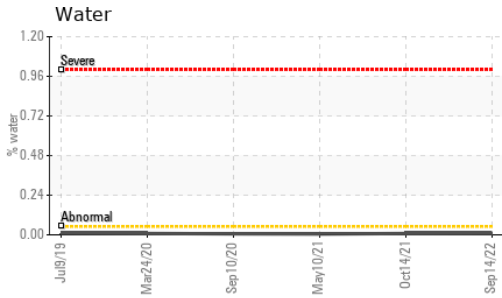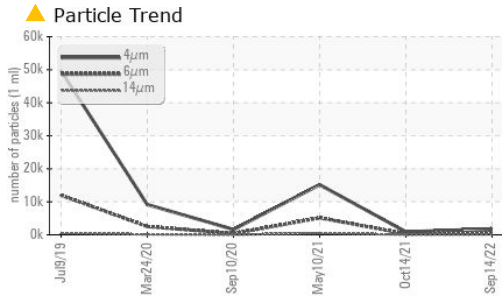






PARAMETER	method	limit/base	current	history 1	history 2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history 1	history 2
Visc @ 40°C	cSt	ASTM D445 46	45.0	45.3	45.2

SAMPLE IMAGES	method	limit/base	current	history 1	history 2
---------------	--------	------------	---------	-----------	-----------

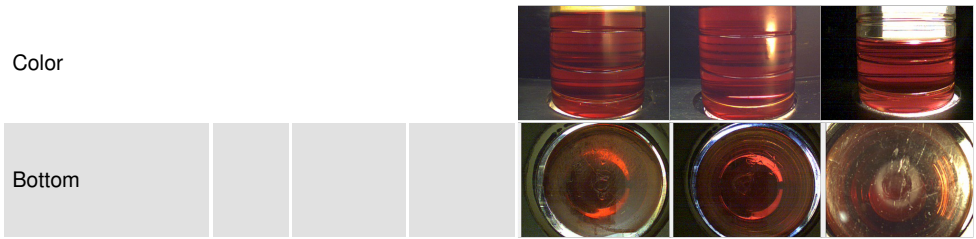

GRAPHS

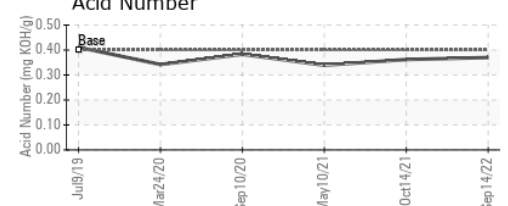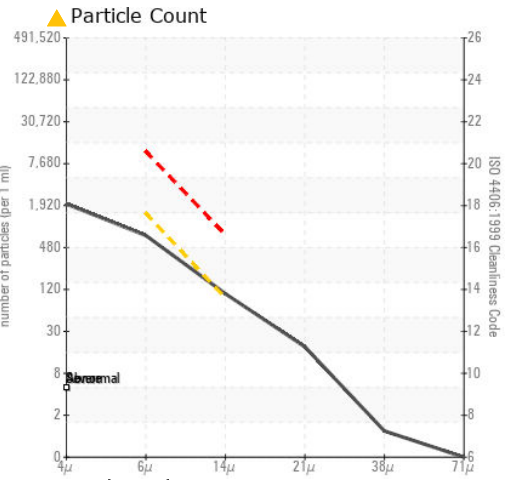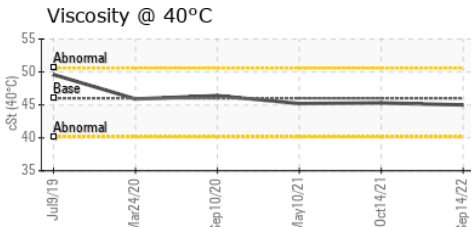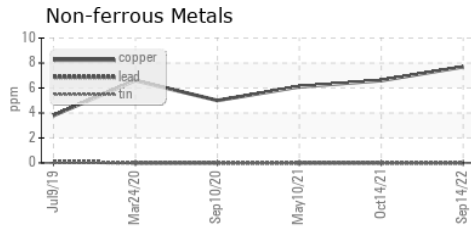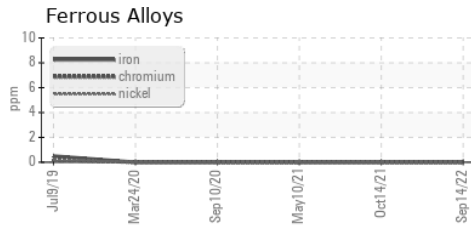

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : KCP49323 **Received** : 20 Sep 2022
Lab Number : 05646600 **Diagnosed** : 22 Sep 2022
Unique Number : 10141139 **Diagnostician** : Jonathan Hester
Test Package : IND 2 (Additional Tests: KF, PrtCount)

SOFIX CORP
 2800 RIVERPORT RD
 CHATTANOOGA, TN
 USA 37406
 Contact:

To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)