KAESER COMPRESSORS®
Built for a lifetime.

PROBLEM SUMMARY

Sample Rating Trend

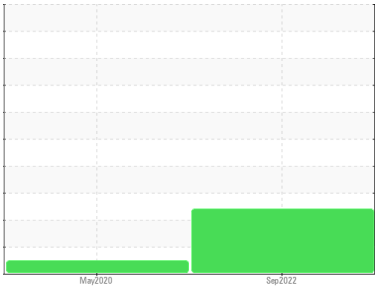

ISO

Machine Id
KAESER AS30 6792647 (S/N 1323)
Component
Compressor
Fluid
KAESER SIGMA (OEM) S-460 (--- GAL)

COMPONENT CONDITION SUMMARY

▲ Particle Trend

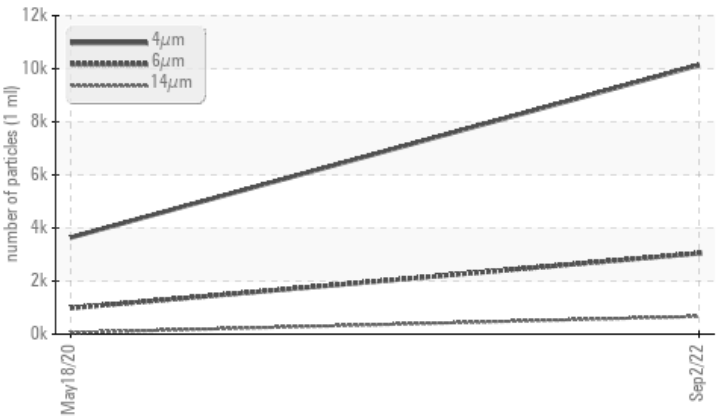

RECOMMENDATION

Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

PROBLEMATIC TEST RESULTS

Sample Status				**ABNORMAL**	NORMAL	---
Particles >6µm		ASTM D7647	>1300	▲ **3046**	982	---
Particles >14µm		ASTM D7647	>80	▲ **668**	58	---
Particles >21µm		ASTM D7647	>20	▲ **283**	11	---
Particles >38µm		ASTM D7647	>4	▲ **39**	0	---
Particles >71µm		ASTM D7647	>3	▲ **3**	0	---
Oil Cleanliness		ISO 4406 (c)	>--/17/13	▲ **21/19/17**	17/13	---

Customer Id: HEAPON
Sample No.: KCP30907
Lab Number: 05646618
Test Package: IND 2

To manage this report scan the QR code

To discuss the diagnosis or test data:
Jonathan Hester +1 919-379-4092 x4092
jhester@wearcheckusa.com

To change component or sample information:
Customer Service +1 1-800-237-1369
customerservice@wearcheck.com

RECOMMENDED ACTIONS

Action	Status	Date	Done By	Description
Change Fluid	---	---	?	Oil and filter change at the time of sampling has been noted.
Change Filter	---	---	?	Oil and filter change at the time of sampling has been noted.

HISTORICAL DIAGNOSIS

18 May 2020 Diag: Don Baldridge

NORMAL

Resample at the next service interval to monitor.All component wear rates are normal. The amount and size of particulates present in the system are acceptable. There is no indication of any contamination in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report

KAESER COMPRESSORS
Built for a lifetime.

OIL ANALYSIS REPORT

Sample Rating Trend

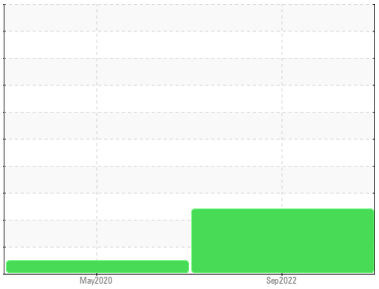

ISO

Machine Id
KAESER AS30 6792647 (S/N 1323)
Component
Compressor
Fluid
KAESER SIGMA (OEM) S-460 (--- GAL)

DIAGNOSIS

Recommendation
Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

Wear
All component wear rates are normal.

Contamination
There is a high amount of particulates present in the oil.

Fluid Condition
The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION	method	limit/base	current	history 1	history 2
Sample Number			**KCP30907**	KCP25223	---
Sample Date			**02 Sep 2022**	18 May 2020	---
Machine Age	hrs		**17962**	4826	---
Oil Age	hrs		**5906**	4826	---
Oil Changed			**Changed**	Changed	---
Sample Status			**ABNORMAL**	NORMAL	---

WEAR METALS		method	limit/base	current	history 1	history 2
Iron	ppm	ASTM D5185m	>50	**0**	1	---
Chromium	ppm	ASTM D5185m	>10	**0**	0	---
Nickel	ppm	ASTM D5185m	>3	**0**	0	---
Titanium	ppm	ASTM D5185m	>3	**0**	0	---
Silver	ppm	ASTM D5185m	>2	**0**	0	---
Aluminum	ppm	ASTM D5185m	>10	**0**	<1	---
Lead	ppm	ASTM D5185m	>10	**0**	0	---
Copper	ppm	ASTM D5185m	>50	**16**	13	---
Tin	ppm	ASTM D5185m	>10	**0**	0	---
Antimony	ppm	ASTM D5185m		**---**	1	---
Vanadium	ppm	ASTM D5185m		**0**	0	---
Cadmium	ppm	ASTM D5185m		**0**	0	---

ADDITIVES		method	limit/base	current	history 1	history 2
Boron	ppm	ASTM D5185m		**0**	<1	---
Barium	ppm	ASTM D5185m	90	**0**	0	---
Molybdenum	ppm	ASTM D5185m		**0**	0	---
Manganese	ppm	ASTM D5185m		**0**	<1	---
Magnesium	ppm	ASTM D5185m	90	**0**	37	---
Calcium	ppm	ASTM D5185m	2	**0**	<1	---
Phosphorus	ppm	ASTM D5185m		**1**	4	---
Zinc	ppm	ASTM D5185m		**0**	18	---
Sulfur	ppm	ASTM D5185m		**13982**	15372	---

CONTAMINANTS		method	limit/base	current	history 1	history 2
Silicon	ppm	ASTM D5185m	>25	**<1**	<1	---
Sodium	ppm	ASTM D5185m		**0**	19	---
Potassium	ppm	ASTM D5185m	>20	**0**	2	---
Water	%	ASTM D6304	>0.05	**0.006**	0.018	---
ppm Water	ppm	ASTM D6304	>500	**64.3**	186.0	---

FLUID CLEANLINESS	method	limit/base	current	history 1	history 2
Particles >4µm	ASTM D7647		**10136**	3639	---
Particles >6µm	ASTM D7647	>1300	▲ **3046**	982	---
Particles >14µm	ASTM D7647	>80	▲ **668**	58	---
Particles >21µm	ASTM D7647	>20	▲ **283**	11	---
Particles >38µm	ASTM D7647	>4	▲ **39**	0	---
Particles >71µm	ASTM D7647	>3	▲ **3**	0	---
Oil Cleanliness	ISO 4406 (c)	>--/17/13	▲ **21/19/17**	17/13	---

FLUID DEGRADATION		method	limit/base	current	history 1	history 2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.4	**0.38**	0.313	---

KAESER COMPRESSORS®
Built for a lifetime.

OIL ANALYSIS REPORT

Particle Trend

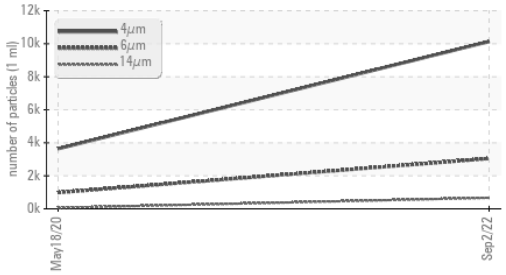

Water

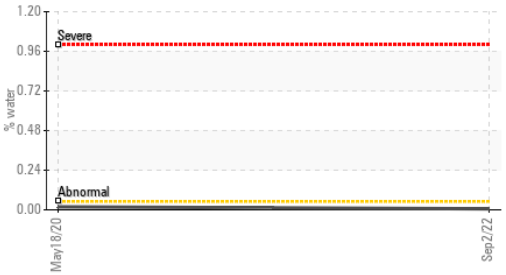

VISUAL		method	limit/base	current	history 1	history 2
White Metal	scalar	*Visual	NONE	**NONE**	NONE	---
Yellow Metal	scalar	*Visual	NONE	**NONE**	NONE	---
Precipitate	scalar	*Visual	NONE	**NONE**	NONE	---
Silt	scalar	*Visual	NONE	**NONE**	NONE	---
Debris	scalar	*Visual	NONE	**NONE**	NONE	---
Sand/Dirt	scalar	*Visual	NONE	**NONE**	NONE	---
Appearance	scalar	*Visual	NORML	**NORML**	NORML	---
Odor	scalar	*Visual	NORML	**NORML**	NORML	---
Emulsified Water	scalar	*Visual	>0.05	**NEG**	NEG	---
Free Water	scalar	*Visual		**NEG**	NEG	---

FLUID PROPERTIES		method	limit/base	current	history 1	history 2
Visc @ 40°C	cSt	ASTM D445	46	**45.9**	44.6	---

SAMPLE IMAGES	method	limit/base	current	history 1	history 2
Color					*no image*
Bottom					*no image*

GRAPHS

Ferrous Alloys

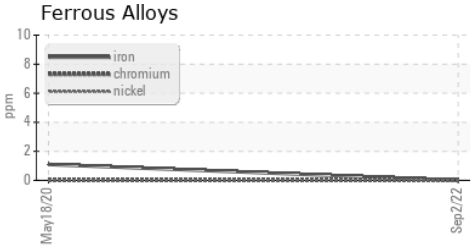

Non-ferrous Metals

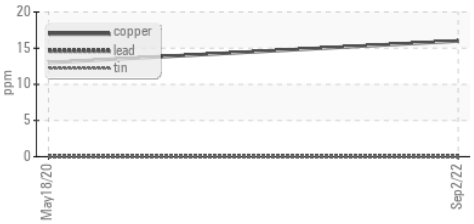

Viscosity @ 40°C

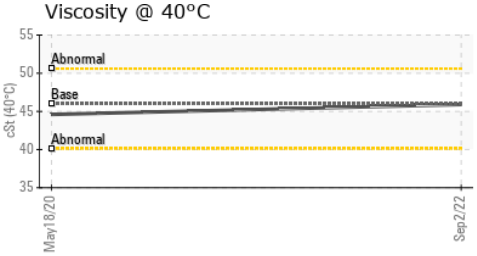

Particle Count

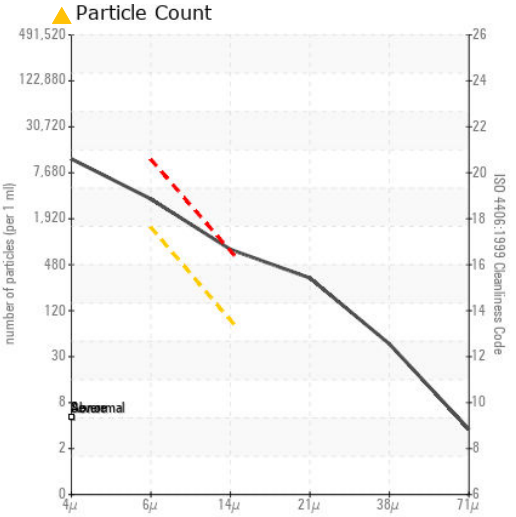

Acid Number

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : KCP30907 **Received** : 20 Sep 2022
Lab Number : 05646618 **Diagnosed** : 22 Sep 2022
Unique Number : 10141157 **Diagnostician** : Jonathan Hester
Test Package : IND 2 (Additional Tests: KF, PrtCount)

To discuss this sample report, contact Customer Service at 1-800-237-1369.
** - Denotes test methods that are outside of the ISO 17025 scope of accreditation.*
Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

HEAD COUNTRY FOOD PRODUCTS INC
2116 N ASH ST
PONCA CITY, OK
USA 74601
Contact: SERVICE MANAGER
T:
F: