


PROBLEM SUMMARY

Sample Rating Trend



ISO

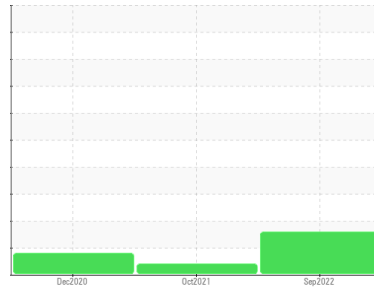


Machine Id
6977208 (S/N 1266)

Component
Compressor
Fluid
KAESER SIGMA (OEM) S-460 (--- GAL)

COMPONENT CONDITION SUMMARY

▲ Particle Trend

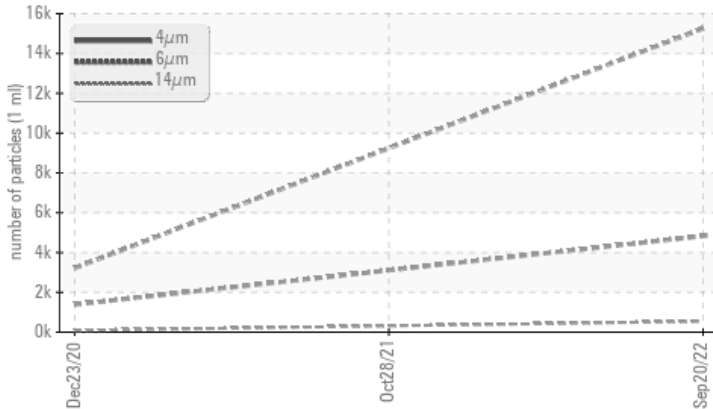

RECOMMENDATION

No corrective action is recommended at this time. Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

PROBLEMATIC TEST RESULTS

Sample Status			ABNORMAL	ABNORMAL	ATTENTION
Particles >6µm	ASTM D7647	>1300	▲ 4826	---	▲ 1390
Particles >14µm	ASTM D7647	>80	▲ 543	---	▲ 84
Particles >21µm	ASTM D7647	>20	▲ 121	---	15
Oil Cleanliness	ISO 4406 (c)	>--/17/13	▲ 21/19/16	---	▲ 18/14

Customer Id: EBDMAS
Sample No.: KC107439
Lab Number: 05648921
Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:
Angela Borella +1 800-237-1369
angela.borella@wearcheckusa.com

To change component or sample information:
Customer Service +1 1-800-237-1369
customerservice@wearcheck.com

RECOMMENDED ACTIONS

Action	Status	Date	Done By	Description
Change Fluid	---	---	?	Oil and filter change at the time of sampling has been noted.
Change Filter	---	---	?	Oil and filter change at the time of sampling has been noted.

HISTORICAL DIAGNOSIS

28 Oct 2021 Diag: Don Baldrige

VIS DEBRIS



No corrective action is recommended at this time. Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor. We were unable to perform a particle count due to a high concentration of particles present in this sample. All component wear rates are normal. Moderate concentration of visible dirt/debris present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

[view report](#)



23 Dec 2020 Diag: Jonathan Hester

ISO




No corrective action is recommended at this time. Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor. All component wear rates are normal. There is a moderate amount of particulates present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

[view report](#)





Machine Id
6977208 (S/N 1266)
Component
Compressor
Fluid
KAESER SIGMA (OEM) S-460 (--- GAL)

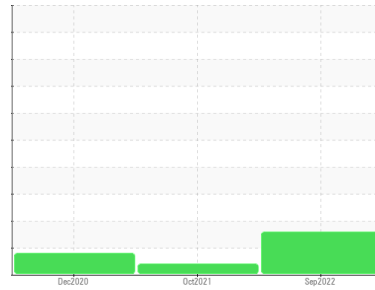

DIAGNOSIS

Recommendation

No corrective action is recommended at this time. Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is a high amount of particulates present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

	method	limit/base	current	history 1	history 2
Sample Number			KC107439	KC86366	KC73825
Sample Date			20 Sep 2022	28 Oct 2021	23 Dec 2020
Machine Age	hrs		9520	7136	4501
Oil Age	hrs		1500	2910	524
Oil Changed			Changed	Changed	Changed
Sample Status			ABNORMAL	ABNORMAL	ATTENTION

WEAR METALS

	method	limit/base	current	history 1	history 2
Iron	ppm	ASTM D5185m >50	<1	<1	0
Chromium	ppm	ASTM D5185m >10	0	0	0
Nickel	ppm	ASTM D5185m >3	0	0	0
Titanium	ppm	ASTM D5185m >3	0	0	0
Silver	ppm	ASTM D5185m >2	0	0	0
Aluminum	ppm	ASTM D5185m >10	0	0	0
Lead	ppm	ASTM D5185m >10	0	0	0
Copper	ppm	ASTM D5185m >50	5	3	9
Tin	ppm	ASTM D5185m >10	0	0	0
Antimony	ppm	ASTM D5185m	---	0	0
Vanadium	ppm	ASTM D5185m	0	0	0
Cadmium	ppm	ASTM D5185m	0	0	0

ADDITIVES

	method	limit/base	current	history 1	history 2
Boron	ppm	ASTM D5185m	0	<1	0
Barium	ppm	ASTM D5185m 90	18	14	6
Molybdenum	ppm	ASTM D5185m	0	0	0
Manganese	ppm	ASTM D5185m	<1	<1	0
Magnesium	ppm	ASTM D5185m 90	61	65	56
Calcium	ppm	ASTM D5185m 2	<1	2	0
Phosphorus	ppm	ASTM D5185m	14	3	4
Zinc	ppm	ASTM D5185m	4	0	0

CONTAMINANTS

	method	limit/base	current	history 1	history 2
Silicon	ppm	ASTM D5185m >25	<1	<1	0
Sodium	ppm	ASTM D5185m	20	27	25
Potassium	ppm	ASTM D5185m >20	3	4	3
Water	%	ASTM D6304 >0.05	0.036	0.028	0.017
ppm Water	ppm	ASTM D6304 >500	362.5	281.1	175.9

FLUID CLEANLINESS


	method	limit/base	current	history 1	history 2
Particles >4µm	ASTM D7647		15255	---	3223
Particles >6µm	ASTM D7647 >1300		▲ 4826	---	▲ 1390
Particles >14µm	ASTM D7647 >80		▲ 543	---	▲ 84
Particles >21µm	ASTM D7647 >20		▲ 121	---	15
Particles >38µm	ASTM D7647 >4		6	---	0
Particles >71µm	ASTM D7647 >3		0	---	0
Oil Cleanliness	ISO 4406 (c) >--/17/13		▲ 21/19/16	---	▲ 18/14

FLUID DEGRADATION


	method	limit/base	current	history 1	history 2
Acid Number (AN)	mg KOH/g	ASTM D8045 0.4	0.39	0.343	0.326

OIL ANALYSIS REPORT

▲ Particle Trend

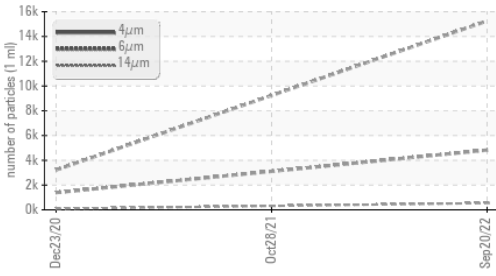

Water

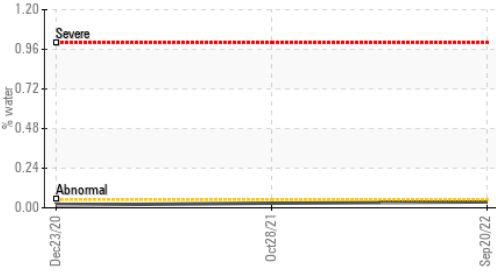


VISUAL	method	limit/base	current	history 1	history 2
White Metal	scalar	*Visual	NONE	VLITE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	▲ MODER
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG


FLUID PROPERTIES	method	limit/base	current	history 1	history 2
Visc @ 40°C	cSt	ASTM D445	46	44.3	44.4

SAMPLE IMAGES	method	limit/base	current	history 1	history 2
---------------	--------	------------	---------	-----------	-----------

Color




Bottom




GRAPHS


Ferrous Alloys

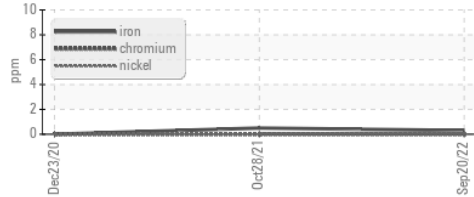


Non-ferrous Metals

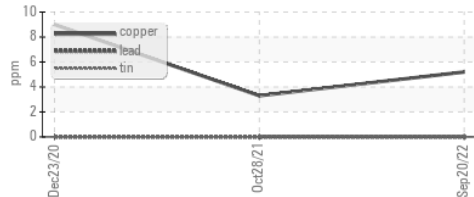


Viscosity @ 40°C

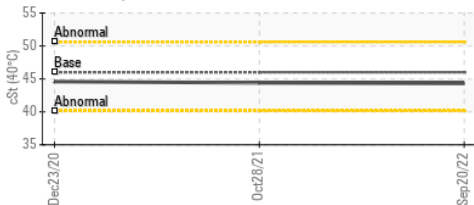

▲ Particle Count

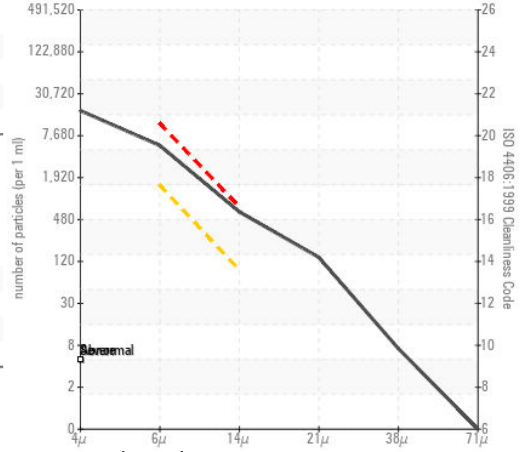

Acid Number

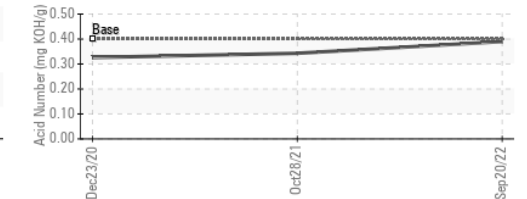

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : KC107439 **Received** : 22 Sep 2022
Lab Number : 05648921 **Diagnosed** : 26 Sep 2022
Unique Number : 10143460 **Diagnostician** : Angela Borella
Test Package : IND 2

EB DISPLAY
 1369 SANDERS AVE SW
 MASSILLON, OH
 USA 44648
 Contact: Service Manager

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:
F: