

PROBLEM SUMMARY

Sample Rating Trend



Machine Id


KAESER DSD 250 7885954 (S/N 2276)

Component

Compressor

KAESER SIGMA (OEM) M-460 (--- GAL)

COMPONENT CONDITION SUMMARY

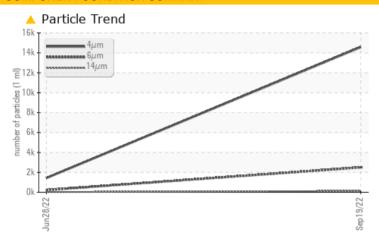

RECOMMENDATION

Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

PROBLEMATIC TEST RESULTS							
Sample Status			ABNORMAL	NORMAL			
Particles >6µm	ASTM D7647	>1300	2503	222			
Particles >14μm	ASTM D7647	>80	129	22			
Oil Cleanliness	ISO 4406 (c)	>/17/13	21/19/14	18/15/12			

Customer Id: CONATLGA Sample No.: KCP49059 Lab Number: 05648928 Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data: Jonathan Hester +1 919-379-4092 x4092 jhester@wearcheckusa.com

To change component or sample information: Customer Service +1 1-800-237-1369 customerservice@wearcheck.com

Action Status Date Done By Description Change Fluid --- ? Oil and filter change at the time of sampling has been noted. Change Filter --- ? Oil and filter change at the time of sampling has been noted.

HISTORICAL DIAGNOSIS

28 Jun 2022 Diag: Don Baldridge

NORMAL



Resample at the next service interval to monitor. All component wear rates are normal. The amount and size of particulates present in the system are acceptable. There is no indication of any contamination in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.





OIL ANALYSIS REPORT

Sample Rating Trend

ISO

KAESER DSD 250 7885954 (S/N 2276)

Compressor

KAESER SIGMA (OEM) M-460 (--- GAL)

DIAGNOSIS

Recommendation

Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

All component wear rates are normal.

Contamination

There is a high amount of particulates present in the oil.


Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

			Jun 2022	Sep2022		
SAMPLE INFORM	MATION	method	limit/base	current	history 1	history 2
Sample Number				KCP49059	KCP51350	
Sample Date				19 Sep 2022	28 Jun 2022	
Machine Age	hrs			4829	3587	
Oil Age	hrs			4829	3587	
Oil Changed				Changed	Changed	
Sample Status				ABNORMAL	NORMAL	
WEAR METALS		method	limit/base	current	history 1	history 2
Iron	ppm	ASTM D5185m	>50	<1	<1	
Chromium	ppm	ASTM D5185m	>10	0	0	
Nickel	ppm	ASTM D5185m	>3	0	0	
Titanium	ppm	ASTM D5185m	>3	0	0	
Silver	ppm	ASTM D5185m	>2	0	0	
Aluminum	ppm	ASTM D5185m	>10	0	<1	
Lead	ppm	ASTM D5185m	>10	0	0	
Copper	ppm	ASTM D5185m	>50	<1	3	
Tin	ppm	ASTM D5185m	>10	0	0	
Vanadium	ppm	ASTM D5185m		0	0	
Cadmium	ppm	ASTM D5185m		0	0	
ADDITIVES		method	limit/base	current	history 1	history 2
Boron	ppm	ASTM D5185m	0	0	0	
Barium	ppm	ASTM D5185m	90	21	6	
Molybdenum	ppm	ASTM D5185m	0	0	0	
Manganese	ppm	ASTM D5185m		<1	0	
Magnesium	ppm	ASTM D5185m	100	80	44	
Calcium	ppm	ASTM D5185m	0	2	0	
Phosphorus	ppm	ASTM D5185m	0	12	4	
Zinc	ppm	ASTM D5185m	0	0	1	
Sulfur	ppm	ASTM D5185m	23500	20994	18207	
CONTAMINANTS		method	limit/base	current	history 1	history 2
Silicon	ppm	ASTM D5185m	>25	<1	<1	
Sodium	ppm	ASTM D5185m		19	10	
Potassium	ppm	ASTM D5185m	>20	7	2	
Water	%	ASTM D6304	>0.05	0.032	0.022	
ppm Water	ppm	ASTM D6304	>500	329.9	223.7	
FLUID CLEANLIN	IESS	method	limit/base	current	history 1	history 2
Particles >4µm		ASTM D7647		14577	1431	
Particles >6µm		ASTM D7647	>1300	<u>^</u> 2503	222	
Particles >14µm		ASTM D7647	>80	<u> </u>	22	
Particles >21µm		ASTM D7647	>20	16	9	
Particles >38μm		ASTM D7647	>4	1	1	
Particles >71μm		ASTM D7647	>3	0	0	
Oil Cleanliness		ISO 4406 (c)	>/17/13	<u> </u>	18/15/12	
FLUID DEGRADA	TION	method	limit/base	current	history 1	history 2
Acid Number (AN)	mg KOH/g	ASTM D8045	1.0	0.42	0.36	



OIL ANALYSIS REPORT

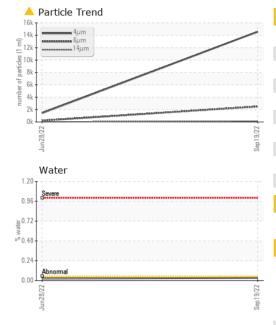



Ferrous Alloys	▲ Particle Count	
7	491,520	
iron	122,880	
6 - manananana nickel	122,000	
+	30,720	
2	7,680	
Jun28/22	Sep 1927	
∃ Non-ferrous Metals	Se di	
Titori-remous metals	to do	
copper	120	
6 - announcement tin	30	
	8 Sbrese mal	
7.722	2-	
Jun28/22	Sep 19/22	
Viscosity @ 40°C	4μ 6μ 14μ Acid Number	21μ 38μ 7
Severe		
T T	9 0.96 	
Abnomal Base Abnomal	(S) 1.20 H) 0.96 (E) 0.72 (E) 0.48 (F) 0.24 (F) 0.00	
Abnormal	TE U.48	
Severe	Pio A Poi	
Jun28/22	Sep 19/22	



Certificate L2367

Laboratory Sample No. Lab Number Unique Number

Bottom

: KCP49059 : 05648928 : 10143467

: WearCheck USA - 501 Madison Ave., Cary, NC 27513 Received : 22 Sep 2022 Diagnosed

: 26 Sep 2022 Diagnostician : Jonathan Hester

Test Package : IND 2 (Additional Tests: KF, PrtCount)

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

CONSOLIDATED CONTAINER COMPANY

6220 DUSQUESNE DR ATLANTA, GA

USA 30336

no image

Contact: SERVICE MANAGER

T: F: