

PROBLEM SUMMARY

Sample Rating Trend

ISO


Machine Id **6357374 (S/N 1875)**

Component

Compressor

KAESER SIGMA (OEM) M-460 (--- QTS)

COMPONENT CONDITION SUMMARY

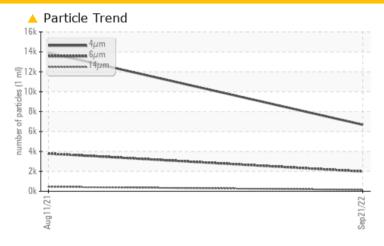

RECOMMENDATION

No corrective action is recommended at this time. Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

PROBLEMATIC TEST F	RESULTS				
Sample Status			ATTENTION	ABNORMAL	
Particles >6µm	ASTM D7647	>1300	1983	△ 3785	
Particles >14μm	ASTM D7647	>80	142	▲ 452	
Particles >21µm	ASTM D7647	>20	4 34	<u> </u>	
Oil Cleanliness	ISO 4406 (c)	>/17/13	20/18/14	1 9/16	

Customer Id: RELUNI Sample No.: KCP37359 Lab Number: 05648951 Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data: Jonathan Hester +1 919-379-4092 x4092 jhester@wearcheckusa.com

To change component or sample information: Customer Service +1 1-800-237-1369 customerservice@wearcheck.com

RECOMMENDED	ACTIONS			
Action	Status	Date	Done By	Description
Change Fluid			?	Oil and filter change at the time of sampling has been noted.
Change Filter			?	Oil and filter change at the time of sampling has been noted.

HISTORICAL DIAGNOSIS

11 Aug 2021 Diag: Angela Borella





Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor. All component wear rates are normal. There is a high amount of particulates present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.





OIL ANALYSIS REPORT



ISO

6357374 (S/N 1875)

Compressor

KAESER SIGMA (OEM) M-460 (--- QTS)

DIAGNOSIS

Recommendation

No corrective action is recommended at this time. Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is a moderate amount of particulates present in the oil.


Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

			Aug2021	Sep2022		
SAMPLE INFORM	MATION	method	limit/base	current	history 1	history 2
Sample Number				KCP37359	KCP21467	
Sample Date				21 Sep 2022	11 Aug 2021	
Machine Age	hrs			18347	14182	
Oil Age	hrs			4000	7015	
Oil Changed				Changed	Changed	
Sample Status				ATTENTION	ABNORMAL	
WEAR METALS		method	limit/base	current	history 1	history 2
Iron	ppm	ASTM D5185m	>50	0	0	
Chromium	ppm	ASTM D5185m	>10	0	0	
Nickel	ppm	ASTM D5185m	>3	0	0	
Titanium	ppm	ASTM D5185m	>3	0	0	
Silver	ppm	ASTM D5185m	>2	0	0	
Aluminum	ppm	ASTM D5185m	>10	0	<1	
Lead	ppm	ASTM D5185m	>10	0	0	
Copper	ppm	ASTM D5185m	>50	12	8	
Tin	ppm	ASTM D5185m	>10	0	0	
Antimony	ppm	ASTM D5185m			0	
Vanadium	ppm	ASTM D5185m		0	0	
Cadmium	ppm	ASTM D5185m		0	0	
ADDITIVES		method	limit/base	current	history 1	history 2
Boron	nnm	ASTM D5185m	0	0	14	
Barium	ppm	ASTM D5185m	90	0	0	
	ppm	ASTM D5185m		0	0	
Molybdenum	ppm	ASTM D5185m	0	0	0	
Manganese	ppm	ASTM D5185m	100	0	0	
Magnesium	ppm		100	0	0	
Calcium	ppm	ASTM D5185m	0	-		
Phosphorus	ppm	ASTM D5185m	0	10	<1	
Zinc	ppm	ASTM D5185m	0	0	0	
Sulfur	ppm	ASTM D5185m	23500	22610	17012	
CONTAMINANTS	3	method	limit/base	current	history 1	history 2
Silicon	ppm	ASTM D5185m	>25	8	21	
Sodium	ppm	ASTM D5185m		0	1	
Potassium	ppm	ASTM D5185m	>20	0	0	
Water	%	ASTM D6304	>0.05	0.009	0.013	
ppm Water	ppm	ASTM D6304	>500	99.4	132.3	
FLUID CLEANLIN	NESS	method	limit/base	current	history 1	history 2
Particles >4µm		ASTM D7647		6683	13902	
Particles >6µm		ASTM D7647	>1300	1983	△ 3785	
Particles >14µm		ASTM D7647	>80	<u> </u>	<u></u> 452	
Particles >21µm		ASTM D7647	>20	4 34	<u> </u>	
Particles >38µm		ASTM D7647	>4	4	<u> </u>	
Particles >71µm		ASTM D7647	>3	0	0	
Oil Cleanliness		ISO 4406 (c)	>/17/13	<u>^</u> 20/18/14	△ 19/16	
FLUID DEGRADA	ATION	method	limit/base	current	history 1	history 2



OIL ANALYSIS REPORT

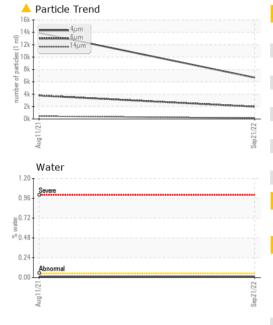



Ferrous Alloys	▲ Particle Count	
	491,520 _T	
iron		
nanananana nickel	122,880	
!	30,720	
	7,680	
Aug11/21.	Sep 21/72	
Augi	7d sa 1,920	
Non-ferrous Metals	Sep 21,227	
copper	120 -	
www.min	30	
	30	
	8 Shream al	
	2	
Aug11/21	22/1/22 2	
	4μ 6μ 14μ	21μ 38μ 7
Viscosity @ 40°C	Acid Number	
Severe	⊋ 1.20 Bassermal	
Abnormal	Q U.56 + T	
Base	1.20 1.20	
Abnormal	E 0.74	
Severe	P 0 00	
1/21	Sep21/22	
Aug1	pp2	



Certificate L2367

Laboratory Sample No. Lab Number Unique Number

: KCP37359 : 05648951 : 10143490

Bottom

: WearCheck USA - 501 Madison Ave., Cary, NC 27513 Received : 22 Sep 2022 Diagnosed

: 26 Sep 2022 Diagnostician : Jonathan Hester

Test Package : IND 2 (Additional Tests: KF, PrtCount) To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

RELIANCE STEEL 33201 WESTERN AVE UNION CITY, CA

USA 94587

no image

Contact: Service Manager

T:

F: